

INDUSTRIAL NEW CONSTRUCTION (INC)

DESIGN REFERENCE GUIDE & SUBMISSION FORMAT

VERSION 1.02 | MARCH 2019

COPYRIGHT

The Green Building Index (GBI) is developed by Greenbuildingindex Sdn Bhd (in short "GSB") for the purposes as mentioned herein and may be subject to updating and/or modification in future.

While every care has been taken by in the development of the GBI to establish and acknowledge copyright of the information and materials used, and contact the copyright owners known to GSB. GSB tender their apologies for any accidental omissions.

Green Building Index and GBI is a copyright of Greenbuildingindex Sdn Bhd (in short "GSB") in which GSB reserves all rights. GSB is the custodian of all rights for GBI. No part of the GBI may be used, modified, reproduced, stored in a retrieval system or transmitted in any form, or by any means, electronic, mechanical, photocopying, recording or otherwise, without the prior written permission of GSB.

DISCLAIMERS

GSB shall not be held liable for any improper or incorrect use of the GBI (inclusive of the materials and/or information contained therein) and assume no responsibility for any user's use of it. In no event shall GSB be liable for any damages whatsoever, whether direct, indirect, incidental, special, exemplary or consequential (including, but not limited to business interruption or loss of use, data or profits) regardless of cause, and on any basis of liability, whether in contract, strict liability or tort (including negligence, misrepresentation or otherwise) arising in any way out of the use of the GBI or the information and materials contained therein.

The information and materials in the GBI are provided "as is" and without warranties of any kind expressed or implied. GSB do not warrant or make representations as to the accuracy and completeness of any information and/or materials contained therein. While every effort has been made to check the accuracy and completeness of the information and materials given, the users should always make their own relevant checks. Accordingly, GSB do not accept responsibility and liability for misstatements made in it or misunderstanding from it.

The GBI is no substitute for professional advice. Users are advised to consult with appropriate and accredited professional advisors for advice concerning specific matters pertaining to the GBI before adopting or using it. GSB disclaim any responsibility for positions taken by users in their individual cases or for any misunderstandings and losses, direct or indirectly, on the part of the users.

GSB do not endorse or otherwise acknowledge the GBI rating achieved by the use of the GBI.GSB offer a formal certification process for ratings; which service provides for independent third party review of points claimed to ensure that all credits can be demonstrated to be achieved by the provision of the necessary documentary evidence. Use of the GBI without formal certification by GSB does not entitle the user or any other party to promote the achieved GBI rating.

INDEMNIFICATION

To the extent permitted by applicable law, by using GSB's GBI, the user agrees to defend, indemnify, and hold harmless, GSB, their officers, employees, members, representatives and agents from and against all claims and expenses of whatsoever kind and amount, arising out of the user's use of the GBI or materials and information contained therein and not to pursue any cause of action whatsoever against GSB under any conceivable circumstances.

CONTENTS

INDUSTRIAL NEW CONSTRUCTION (INC)

- 2 **COPYRIGHT**
- 4 INTRODUCTION
- 6 PROCEDURES
- 10 CRITERIA CHECKLIST & SUBMISSION FORMAT

ASSESSMENT CRITERIA

- 18 ENERGY EFFICIENCY (EE)
- 28 INDOOR ENVIRONMENTAL QUALITY (EQ)
- 45 SUSTAINABLE SITE PLANNING & MANAGEMENT (SM)
- **62** MATERIALS & RESOURCES (MR)
- **72** WATER EFFICIENCY (WE)
- 78 INNOVATION (IN)
- 81 **ACKNOWLEDGEMENTS**

INTRODUCTION

The purpose of the Green Building Index Design Reference Guide is to establish a guidance document to assist project teams in understanding the criteria for each of the main components of the Green Building Index Rating Tool. The project team can use the document as a guide when submitting for the Green Building Index as it clearly identifies examples of how and what is required for completing the submission. Each of the main six criteria's are further divided into the corresponding sub-sections in obtaining the necessary credit points. This guide is indicative and not an exhaustive/definitive reference to the Green Building Index rating tool.

The basic framework of this document sets out for each subsection the intent, description, requirements, approach & implementation and in some occasions, calculations to achieve the credit point for each subsection. The Green Building Index Design Reference Guide further becomes the base curriculum for the training of facilitators on the Green Building Index Rating Tools.

To attain the Green Building Index classification, the procedures are as follows:

STAGE 1 APPLICATION & REGISTRATION STAGE 2 DESIGN ASSESSMENT (DA)

STAGE 3 COMPLETION & VERIFICATION ASSESSMENT (CVA)

A summary of the stages is described below:

STAGE 1 | APPLICATION & REGISTRATION

Complete and Submit application form with Owner's information, project contact details, project information and any supporting documents to Greenbuildingindex Sdn Bhd (GSB). Upon acceptance & approval of the application documentation, the registration fee will be confirmed dependent on the size of the project. On payment of fees, a GBI registration number will be given, and the terms and conditions duly signed between owner and GSB. A GBI Certifier will be assigned for the duration of the project.

GBI Registration Fees can be obtained from www.greenbuildingindex.org

GBI Terms & Conditions

An agreement setting out the terms and conditions between Project owner and Greenbuildingindex Sdn Bhd is to be duly signed at this stage.

STAGE 2 | DESIGN ASSESSMENT (DA)

Appraisal conducted upon the submission by the Project Design team / Client (Architect/Engineer/Building Owner or Developer directly or through a GBI Facilitator) of comprehensive design and other necessary documents for Green Building Index Assessment. After acceptance of registration from GBI, the Project Design team & client should proceed to collect information for each of the six criteria completing the submittal requirements described under each detailed sub-section. It is recommended that the information submitted is based on preconstruction information (ie tender documentation stage) when all parameters of the design have been finalised. A Provisional Design Assessment certificate is given at this stage. A summary Design Assessment (DA) checklist is provided to determine target scoring.

GREEN BUILDING INDEX DESIGN REFERENCE GUIDE & SUBMISSION FORMAT

STAGE 3 | COMPLETION & VERIFICATION ASSESSMENT (CVA)

Appraisal conducted upon CPC of the project when all necessary documents are re-submitted according to as-built information and calculations by the Project Design Team / Client (Architect/Engineer/Building Owner or Developer directly or through a GBI Facilitator). The Completion & Verification Assessment confirms that the targeted criteria have been properly implemented and achieved, or otherwise, for the intended classification.

GBI verifies within 12 months of CPC (or CCC/OC/OP whichever is the later); or earlier, if occupancy is not less than 50%, on the project classification. The verification process involves verifying the actual measured energy and water use, sustainable measures, indoor comfort survey results and action plan, Building Manual and Sustainable Maintenance program. A full Certification is given at this stage. A summary Completion & Verification Assessment (CVA) checklist is provided to determine target scoring.

APPEAL PROCEDURES

Appeal can be submitted (with fee paid) after receiving the Design Assessment result or after receiving the Completion & Verification Assessment results.

VALIDITY OF CERTIFICATION

The validity of the certification is limited for three years. This is to encourage sustainable building maintenance management throughout the life of the building.

CERTIFIERS & FACILITATORS

GBI Certifiers perform the detailed assessment and accrediting tasks of building projects submitted to the GBI Accreditation Panel (GBIAP) for final certification.

GBI Facilitators provide services to enable building projects to achieve GBI Accreditation. A GBI Facilitator is a registered person with GSB having completed the training and examinations conducted by GSB.


GBI TERMS & CONDITIONS

An agreement setting out the terms and conditions between the Project owner and Greenbuildingindex Sdn Bhd.




INDUSTRIAL NEW CONSTRUCTION (INC) PROCEDURES

STAGE 1 APPLICATION & REGISTRATION

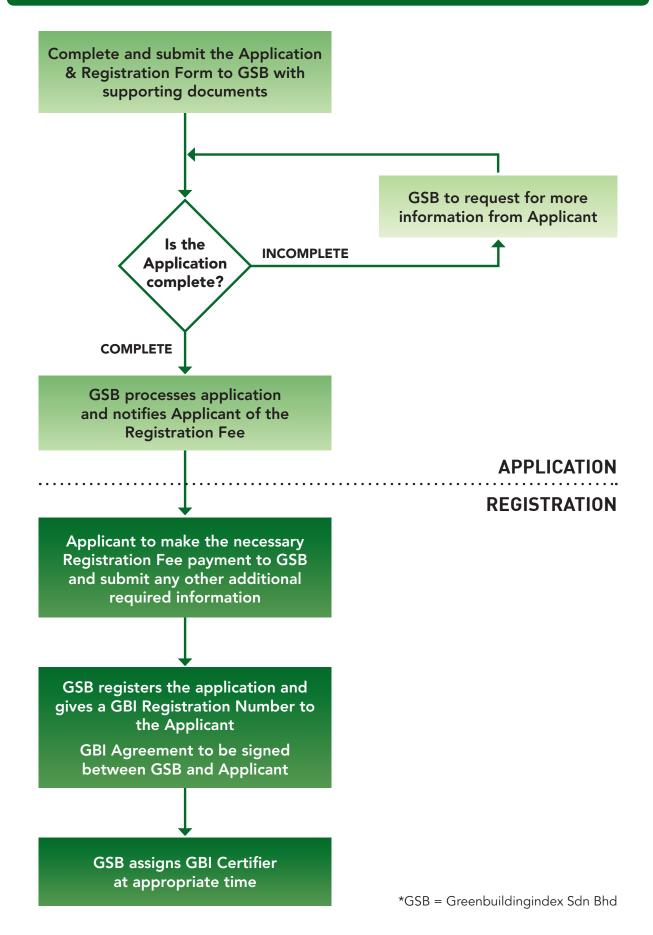


STAGE 2 DESIGN ASSESSMENT (DA)

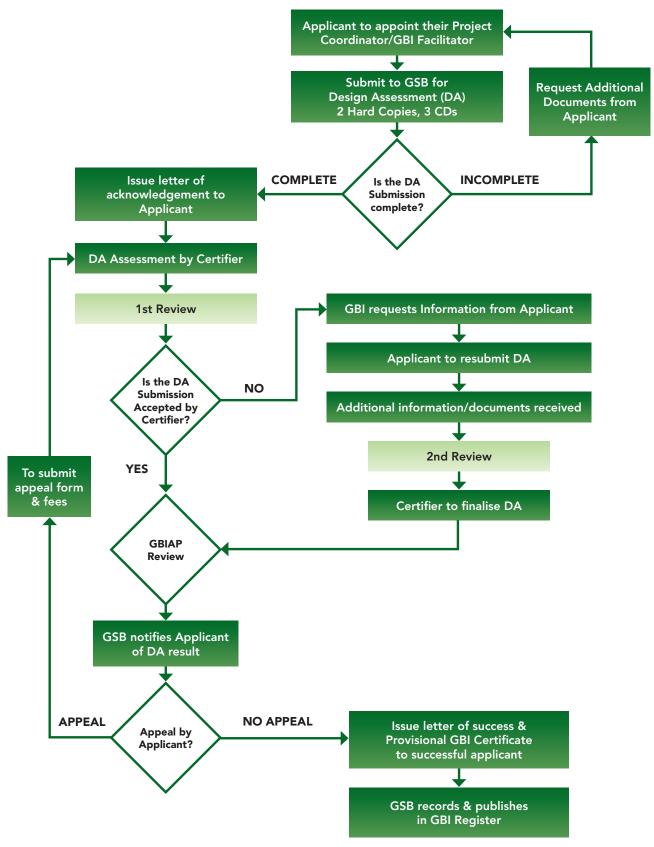

*GSB = Greenbuildingindex Sdn Bhd

STAGE 3 COMPLETION & VERIFICATION ASSESSMENT (CVA)

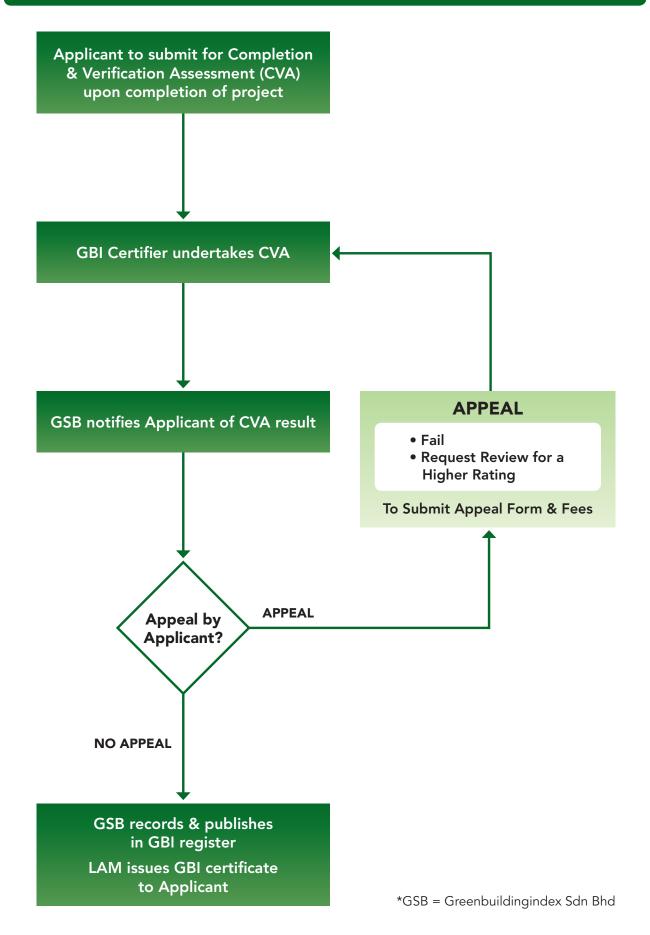



INDUSTRIAL NEW CONSTRUCTION (INC) CRITERIA CHECKLIST & SUBMISSION FORMAT

INDUSTRIAL NEW CONSTRUCTION (INC) PROJECT INFORMATION

NAME OF BUILDING	
ADDRESS OF BUILDING	
POSTCODE	
STATE	
APPLICANT	
CONTACT PERSON	
ARCHITECT	
CIVIL ENGINEER	
STRUCTURAL ENGINEER	
MECHANICAL ENGINEER	
ELECTRICAL ENGINEER	
QUANTITY SURVEYOR	
LAND SURVEYOR	
LANDSCAPE CONSULTANT	
OTHER SPECIALIST CONSULTANT(S)	
MAIN CONTRACTOR	
LOCAL AUTHORITY	
TOTAL GROSS FLOOR AREA	
LAND AREA FOR LANDED PROPERTY	
BUILDING AND INDUSTRIAL PROCESS DESCRIPTION	
DESCRIPTION	

11

VERSION 1.02 | MARCH 2019

INDUSTRIAL NEW CONSTRUCTION (INC)

ASSESSMENT CRITERIA OVERALL POINTS SCORE

PART	ITEM	MAXIMUM POINTS
1	Energy Efficiency (EE)	33
2	Indoor Environmental Quality (EQ)	22
3	Sustainable Site Planning & Management (SM)	18
4	Material & Resources (MR)	10
5	Water Efficiency (WE)	10
6	Innovation (IN)	7
	TOTAL SCORE	100

GREEN BUILDING INDEX CLASSIFICATION

POINTS	GBI RATING
86 to 100 points	Platinum
76 to 85 points	Gold
66 to 75 points	Silver
50 to 65 points	Certified

INDUSTRIAL NEW CONSTRUCTION (INC) ASSESSMENT CRITERIA SCORE SUMMARY

PART	CRITERIA	ITEM	POINTS	SUBMITTER	GBI			
	EE	ENERGY EFFICIENCY	<u> </u>					
	Design							
	EE1	Minimum EE Performance	1					
	EE2	Lighting Zoning	3					
	EE3	Electrical Sub-metering	1					
	EE4	Renewable Energy & Onsite Energy Capture/Recovery	8					
1	EE5	Advanced or Improved EE Performance - BEI and/or EUI	10					
	Commissi	oning						
	EE6	Enhanced Commissioning	4					
	EE7	On-going Post Occupancy Commissioning	2					
	Verification	on & Maintenance						
	EE8	EE Verification	2					
	EE9	Sustainable Maintenance	2					
	EQ	INDOOR ENVIRONMENTAL QUALITY						
	Air Qualit	у						
	EQ1	Minimum IAQ Performance	1					
	EQ2	Environmental Tobacco Smoke (ETS) Control	1					
	EQ3	Carbon Dioxide Monitoring and Control	1					
	EQ4	Indoor Air Pollutant & Industrial Chemical Exposure	3					
	EQ5	Mould Prevention	1					
	Thermal C	Comfort						
	EQ6	Thermal Comfort: Design & Controllability of Systems	2					
	EQ7	Air Change Effectiveness	1					
2	EQ8	Breakout Spaces	1					
	Lighting, Visual & Acoustic Comfort							
	EQ9	Daylighting	2					
	EQ10	Daylight Glare Control	1					
	EQ11	Electric Lighting Levels	1					
	EQ12	High Frequency Ballasts	1					
	EQ13	External Views	2					
	EQ14	Internal Noise Levels	1					
	Verification	on						
	EQ15	IAQ Before & During Occupancy	2					
	EQ16	Post Occupancy Comfort Survey: Verification	1					

GREEN BUILDING INDEX DESIGN REFERENCE GUIDE & SUBMISSION FORMAT

PART	CRITERIA	ITEM	POINTS	SUBMITTER	GBI			
	SM	SUSTAINABLE SITE PLANNING & MANAGEMENT						
	Site Plann	ing						
	SM1	Site Selection	1					
	SM2	Brownfield Redevelopment	1					
	SM3	Development Density & Community Connectivity	2					
	SM4	Environment Management	2					
	SM5	Noise Pollution	1					
	Construct	ion Management						
	SM6	Earthworks - Construction Activity Pollution Control	1					
3	SM7	QLASSIC	1					
3	SM8	Workers Site Amenities	1					
	Transport	ation	,					
	SM9	Public Transportation Access & Transportation Plan	1					
	SM10	Green Vehicle Priority	1					
	SM11	Parking Capacity	1					
	SM12	Cargo Delivery Route and Proximity	1					
	Design							
	SM13	Stormwater Design - Quality & Quantity Control	1					
	SM14	Greenery & Roof	2					
	SM15	Building User Manual	1					
	MR	MATERIALS & RESOURCES						
	Reused &	Recycled Materials						
	MR1	Materials Reuse and Selection	2					
	MR2	Recycled Content Materials	2					
	Sustainable Resources							
4	MR3	Regional Materials	1					
_	MR4	Sustainable Timber	1					
	Waste Management							
	MR5	Storage & Collection of Recyclables	1					
	MR6	Construction Waste Management	2					
	Green Pro	ducts						
	MR6	Refrigerants & Clean Agents	1					
	WE	WATER EFFICIENCY						
	Water Hai	vesting & Recycling	Т					
	WE1	Rainwater Harvesting	2					
5	WE2	Water Recycling	2					
	Increased	Efficiency	r					
	WE3	Water Efficient Irrigation/Landscaping	2					
	WE4	Water Reduction	2					
	WE5	Metering & Leak Detection System	2					
	IN	INNOVATION						
6	IN1	Innovation & Environmental Design Initiatives	6					
	IN2	Green Building Index Facilitator	1					
		TOTAL POINTS	100					

INDUSTRIAL NEW CONSTRUCTION (INC)

The Industrial New Construction (INC) Reference Guide is formatted in reference to the Industrial New Construction (INC) Tool. It is envisaged that this reference guide is a live document that from time to time will be updated for the benefit of the end users.

The Reference guide has been formatted to form part of the basic criteria checklist for all documentation submissions for both the Design Assessment (DA) and Completion & Verification Assessment (CVA). The front cover sheet of the individual criteria is to be attached with documentation drawings, project narratives and technical submissions. The criteria checklist is to be signed by the Principal Submitting Person (in short "PSP"), Submitting Person (in short "SP") or Specialist (in short "S") together with the client's (in short "C"). Where the retrofitting works do not require appointment of the full compliment of consultants, the sole or lead consultant will sign in lieu.

Enclosed the summary checklist together with the corresponding signatories required for each criteria.

PART	CRITERIA	ITEM	REQUIRED SIGNATORIES
	EE	ENERGY EFFICIENCY	
	EE1	Minimum EE Performance	PSP and C
	EE2	Lighting Zoning	SP and C
	EE3	Electrical Sub-metering	SP and C
1	EE4	Renewable Energy & Onsite Energy Capture/Recovery	SP/S and C
	EE5	Advanced or Improved EE Performance – BEI and/or EUI	SP/S and C
	EE6	Enhanced Commissioning	SP/S and C
	EE7	On-going Post Occupancy Commissioning	SP/S and C
	EE8	EE Verification	SP/S and C
	EE9	Sustainable Maintenance	SP/S and C
	EQ	INDOOR ENVIRONMENTAL QUALITY	
	EQ1	Minimum IAQ Performance	SP and C
	EQ2	Environmental Tobacco Smoke (ETS) Control	PSP and C
	EQ3	Carbon Dioxide Monitoring and Control	SP and C
	EQ4	Indoor Air Pollutant & Industrial Chemical Exposure	PSP and C
	EQ5	Mould Prevention	PSP/SP and C
	EQ6	Thermal Comfort: Design & Controllability of Systems	SP and C
	EQ7	Air Change Effectiveness	SP and C
2	EQ8	Breakout Spaces	PSP and C
	EQ9	Daylighting	PSP and C
	EQ10	Daylight Glare Control	PSP and C
	EQ11	Electric Lighting Levels	SP and C
	EQ12	High Frequency Ballasts	SP and C
	EQ13	External Views	PSP and C
	EQ14	Internal Noise Levels	PSP/SP/S and C
	EQ15	IAQ Before & During Occupancy	SP/S and C
	EQ16	Post Occupancy Comfort Survey: Verification	S and C
	SM	SUSTAINABLE SITE PLANNING & MANAGEMENT	
	SM1	Site Selection	PSP and C
	SM2	Brownfield Redevelopment	PSP and C
	SM3	Development Density & Community Connectivity	PSP and C
	SM4	Environment Management	PSP and C
	SM5	Noise Pollution	PSP and C
	SM6	Earthworks – Construction Activity Pollution Control	SP and C
3	SM7	QLASSIC	PSP and C
	SM8	Workers' Site Amenities	PSP and C
	SM9	Public Transportation Access & Transportation Plan	PSP and C
	SM10	Green Vehicle Priority	PSP and C
	SM11	Parking Capacity	PSP and C
	SM12	Cargo Delivery Route and Proximity	PSP and C
	SM 13	Stormwater Design – Quality & Quantity Control	SP and C
	SM14	Greenery & Roof	PSP/SP and C
	SM15	Building User Manual	S and C

GREEN BUILDING INDEX DESIGN REFERENCE GUIDE & SUBMISSION FORMAT

PART	CRITERIA	ITEM	REQUIRED SIGNATORIES
	MR	MATERIALS & RESOURCES	
	MR1	Materials Reuse and Selection	PSP/QS and C
	MR2	Recycled Content Materials	PSP/QS and C
4	MR3	Regional Materials	PSP/QS and C
4	MR4	Sustainable Timber	PSP/QS and C
	MR5	Storage & Collection of Recyclables	PSP/S/QS AND C
	MR6	Construction Waste Management	PSP/QS AND C
	MR7	Refrigerants & Clean Agents	SP and C
	WE	WATER EFFICIENCY	
	WE1	Rainwater Harvesting	PSP/SP/S and C
5	WE2	Water Recycling	SP/S and C
5	WE3	Water Efficient Irrigation/Landscaping	SP and C
	WE4	Water Reduction	PSP/SP/S and C
	WE5	Metering & Leak Detection System	SP and C
	IN	INNOVATION	
6	IN1	Innovation & Environmental Design Initiatives	PSP/SP/S and C
	IN2	Green Building Index Facilitator	S and C

PSP is defined as Architect or Engineer (similar to the definition in Certificate of Completion & Compliance, CCC) **SP** is defined as Engineer, Landscape Architect, Planner and Quantity Surveyor (QS).

\$ is defined as Specialist which includes Facilitator, Project Manager, Facilities Manager, Energy or Sustainable Consultant and Commissioning Specialist.

C is defined as Client or client's assigned representative.

SUBMISSION FORMAT & SIGNATURES

All submission information shall be attached to their respective cover criteria sheet along with relevant signatures for each of the criteria. The criteria checklist is to be marked by the submitter on all project documentation as described under "Required Submission for Design Assessment (DA)" or "Required Submission for Completion & Verification Assessment (CVA)". Please leave the GBI's column for the administration of GSB. All documents must be duly verified and signed as part of the procedural requirements. GSB will return documents that are not submitted in full compliance for corrective action.

The following is the recommended format of all documents that will form the Design Assessment (DA) & Completion & Verification Assessment (CVA) submission;

- 1. All Drawings, Plans, Sections and Elevations to be formatted on A3 size paper, with respective scale or scales clearly indicated. Should drawings be too small for legibility, provide a key plan with part plans for full clarity of building information.
- 2. All Perspectives to fit A3 size paper.
- 3. All Reports to be A4 format. Signature of Qualified submitting professional should form part of the submission.
- 4. Clearly mark the Design Assessment Checklist or Completion & Verification Checklist on submission of documentations together with a Design Submission form.

All submission to be saved into CDROM pdf format. Two (2) hard copies and three (3) copies of CDROM are to be submitted to GSB.



INDUSTRIAL NEW CONSTRUCTION (INC) ASSESSMENT CRITERIA

ENERGY EFFICIENCY (EE)

EE1 MINIMUM EE PERFORMANCE 1 POINT

INTENT

To create energy efficiency (EE) awareness and promote the use of MS 1525.

DESCRIPTION

Establish minimum energy efficiency (EE) performance to reduce energy consumption in industrial buildings, thus reducing CO₂ emission to the atmosphere. Meet the following minimum EE requirements as stipulated in MS 1525.

REQUIREMENTS

Submit calculations for Overall Thermal Transfer Value (OTTV) \leq 50 and Roof Thermal Transfer Value (RTTV) \leq 25. Use of the BEIT software or other GBI approved software is acceptable,

AND

Provision of Energy Management System where Air Conditioned space ≥ 4,000m²

APPROACH & IMPLEMENTATION

Wall insulation can be achieved in many ways, such as, but not limited to, using autoclaved lightweight concretes, composite insulated walls, double brickwalls and many other construction systems. Glazing should be optimally sized. The use of Insulated Glazing Units and/or performance glazing such as low-e and/or spectrally selective glazing is encouraged. Roof should be insulated with suitable insulation materials to prevent heat gain into occupied spaces.

POTENTIAL TECHNOLOGIES & STRATEGIES

Design the building envelope, HVAC, lighting and other systems to maximize energy performance.

REQUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)					SUBMITTER	GBI
1.		Plans and elevations marking out walls & apertures used for the calculation coloured blue; and walls & apertures not used for calculation coloured red. Recommended scale 1: 200				0
2.	OTTV ca	culations for each facing wall	and RTTV calculation fo	r roof	\circ	\circ
3.	Descripti	on of wall, roof & aperture ma	aterials specified.		\circ	\bigcirc
4.	Calculation	ons of U-values for roof and w	alls.		\bigcirc	\circ
5.	Proposed Transmiss	d Glazing specifications on sion.	Shading Coefficient,	U-values and Visible Light	0	0
6.	Confirm	provision of Energy Managem	nent System where air co	onditioned space $\geq 4,000$ m ² .	0	0
RE	QUIRED SU	BMISSION FOR COMPLETION	& VERIFICATION ASSES	SSMENT (CVA)	SUBMITTER	GBI
1.	As-Built plans and elevations marking out walls & apertures used for the calculation coloured blue; and walls & apertures not used for calculation coloured red.				\circ	0
2.	OTTV calculations for each facing wall and roof.			\bigcirc	\circ	
3.	Description of built wall & aperture materials with U-value calculation			\circ	\circ	
4.	Manufact Transmis	turer issued glazing specificati sion.	ion on shading coefficier	nt, U-values and Visible Light		0
5.	Descripti	on of as-installed Energy Man	nagement System and I/0	O schedule.	\circ	\bigcirc
6.	Describe	any deviation or addition to t	the DA submission.		\circ	\bigcirc
PR	PROJECT NAME			DATE		
	NAME DESIGNATION COMPANY SUBMITTING PROFESSIONAL			SIGNATURE		
CL	CLIENT DESIGNATION COMPANY		SIGNATURE			

EE2	LIGHTING ZONING	3 POINTS

INTENT

To provide flexible lighting controls so as to optimise energy savings.

DESCRIPTION

Encourage and recognise lighting design practices that offer greater flexibility for light switching, making it easier to light only occupied areas

REQUIREMENTS

- **1 point:** Awarded for all individual or enclosed spaces to be individually switched; and the size of individually switched lighting zones shall not exceed 100m² for 90% of the NLA; with switching clearly labelled and easily accessible by building occupants.
- **1 point:** Awarded for provision of auto-sensor controlled lighting in conjunction with daylighting strategy for all perimeter zones and daylit areas, if any.
- 1 point: Awarded for provision of motion sensors or equivalent to complement lighting zoning for at least 25% NLA.

APPROACH & IMPLEMENTATION

Decreasing the size of lighting zones allows for more flexible control over lighting giving owners/tenants the ability to reduce energy consumption and costs by only lighting those areas or zones that are occupied or required.

POTENTIAL TECHNOLOGIES & STRATEGIES

Design lighting zones by increasing switching flexibility with controls by individual switches and/or automated sensing devices.

RE	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Drawings of floor plans clearly showing every proposed individually switched lighting zone and its coverage area.	0	0
2.	Electrical schematic drawings showing the locations and extent of switching, the area controlled by the switch and automated control sensing system detailed.	\circ	0
3.	Report to include the areas of all switched zones and confirmation that the total areas meet the percentage NLA requirements.	0	0
RE	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	As-Built Drawings of floor plans clearly showing each individually switched lighting zone and its coverage area.	0	\circ
2.	As-Built Electrical schematic drawings showing the locations and extent of switching, the area controlled by the switch and automated control sensing system detailed.	0	0
3.	Report to include the exact areas of all switched zones and confirmation that the total area meets the percentage NLA requirements.	0	0
4.	Describe any deviation or addition to the DA submission.	0	0

NOTE ATTACH ALL SUBMITTALS WITH THIS COVER PAGE

20

COMPANY

COMPANY

DESIGNATION

DESIGNATION

PROJECT NAME

SUBMITTING PROFESSIONAL

CLIENT

ΝΔΜΕ

NAME

DATE

SIGNATURE

SIGNATURE

EE3 ELECTRICAL SUB-METERING 1 POINT

INTENT

To monitor energy consumption of key building services as well as all tenancy and industrial plant areas.

DESCRIPTION

Encourage and recognise the provision of energy sub-metering to facilitate energy monitoring of base building services and industrial plant processes.

REQUIREMENTS

- **1 point:** Provide separate sub-metering for all energy use ≥ 100kVA; with separate sub-metering for
 - 1) Lighting, AND
 - 2) Power, AND
 - 3) Industrial processes

APPROACH & IMPLEMENTATION

For typical industrial buildings, separate metering shall be provided for car parks; chillers; AHUs; lifts; common area lighting and power and any additional item including plant equipment or process which carries an energy use \geq 100kVA.

For speculative industrial buildings, compliance is by demonstrating commitment and provision to install meters for separate tenancy and plant areas. As a minimum this is to be provided on each floor and to each wing or other clearly separable area or zone.

Where Energy Management System (EMS) is provided, all meters should be linked to the EMS for monitoring and recording, and control where appropriate.

POTENTIAL TECHNOLOGIES & STRATEGIES

Utilise Energy Management System (EMS) for measurement and management of energy usage including Maximum Demand Limiting.

REC	NUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	An extract from the specification detailing the installation requirements for electrical submeters that meets the credit criteria.	0	0
2.	Clearly marked electrical schematic drawings showing the proposed locations of meters and the usage served by those meters.	0	0
REC	UIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	As-Built Electrical schematic drawings showing the exact locations of meters and the building usage served by those meters.	\circ	0
2.	Describe any deviation or addition to the DA submission.	\circ	\circ

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

EE4

RENEWABLE ENERGY & ONSITE ENERGY CAPTURE/RECOVERY

8 POINTS

INTENT

To promote use of all forms of renewable energy and/or onsite energy capture/recovery to reduce environmental impact and emission of CO₃.

DESCRIPTION

The use of renewable energy systems and/or onsite energy capture/recovery will help to defer the need for power plant-up and promote green energy use. Calculate the project performance by expressing the energy produced by the renewable energy systems and/or onsite energy capture/recovery as a percentage of the building annual energy use. In the context of the built environment in Malaysia, the most likely form of renewable energy would be derived from BIPV, STC and biomass. Other forms of renewable energy are also applicable with their appropriate conversion into equivalent electrical energy for calculation purposes.

REQUIREMENTS

- **1 point :** Awarded where 0.5% or 5 kWp whichever is the greater, of the equivalent total electricity consumption is generated by Renewable Energy (RE) and/or onsite energy capture/recovery, **OR**
- 2 points: Awarded where 1.0% or 10 kWp whichever is the greater, OR
- 4 points: Awarded where 1.5% or 20 kWp whichever is the greater, OR
- 6 points: Awarded where 2.0% or 40 kWp whichever is the greater, OR
- 8 points: Awarded where 2.5% or 60 kWp whichever is the greater.
- **Notes:** i) Electricity includes other forms of energy.
 - ii) Building annual energy use for this criterion excludes energy consumed by the industrial plant process.

APPROACH & IMPLEMENTATION

Assess the project for renewable energy potential such as solar, wind, geothermal, low-impact hydro, biomass and other non-polluting technologies. Building Integrated Photo Voltaic (BIPV) is recommended to be used to generate renewable electricity in non-residential buildings in the Malaysian climate. The BIPV system can be grid connected or stand-alone system with or without battery pack to store excess energy production. Solar Thermal Cooling (STC) is also highly recommended for application in industrial buildings.

POTENTIAL TECHNOLOGIES & STRATEGIES

Assess the project for non-polluting and renewable energy potential such as solar, wind, geothermal, low-impact hydro, biomass and bio-gas strategies. When applying these strategies, take advantage of FiT where applicable.

REQUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)					GBI
Plans and	l elevations marking out areas	allocated to house rene	ewable energy equipment.	0	0
Describe proposed technology to be used, including documenting total kWp or equivalent to be installed.				\circ	\circ
		nption by the building a	nd percentage of renewable	0	0
QUIRED SU	BMISSION FOR COMPLETION	& VERIFICATION ASSES	SSMENT (CVA)	SUBMITTER	GBI
		out installation and lo	cation of renewable energy	0	0
Manufact	urer's technical specification of	the renewable energy ec	quipment.	\bigcirc	\circ
As-Measu	red kWp or equivalent renewa	ble energy generated.		\circ	\circ
Describe	any deviation or addition to the	e DA submission.		\bigcirc	\bigcirc
OJECT NAME				DATE	
SUBMITTING DESIGNATION COMPANY				SIGNATURE	
OFESSIONAL					
	NAME	DESIGNATION	COMPANY	SIGNATURE	
ENT					
	Plans and Describe to be instructed for the energy to Pulked SU As-Built pequipmer Manufact As-Measu Describe	Plans and elevations marking out areas Describe proposed technology to be u to be installed. Predict reduced total electricity consun energy to be generated. DUIRED SUBMISSION FOR COMPLETION As-Built plans and elevations marking equipment. Manufacturer's technical specification of As-Measured kWp or equivalent renewa Describe any deviation or addition to the	Plans and elevations marking out areas allocated to house rend Describe proposed technology to be used, including document to be installed. Predict reduced total electricity consumption by the building a energy to be generated. DUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSED As-Built plans and elevations marking out installation and lo equipment. Manufacturer's technical specification of the renewable energy expenses any deviation or addition to the DA submission. DESCRIBED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSED As-Built plans and elevations marking out installation and lo equipment. Manufacturer's technical specification of the renewable energy expenses any deviation or addition to the DA submission.	Plans and elevations marking out areas allocated to house renewable energy equipment. Describe proposed technology to be used, including documenting total kWp or equivalent to be installed. Predict reduced total electricity consumption by the building and percentage of renewable energy to be generated. DUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA) As-Built plans and elevations marking out installation and location of renewable energy equipment. Manufacturer's technical specification of the renewable energy equipment. As-Measured kWp or equivalent renewable energy generated. Describe any deviation or addition to the DA submission. DESIGNATION DESIGNATION COMPANY DESIGNATION COMPANY	Plans and elevations marking out areas allocated to house renewable energy equipment. Describe proposed technology to be used, including documenting total kWp or equivalent to be installed. Predict reduced total electricity consumption by the building and percentage of renewable energy to be generated. PUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA) SUBMITTER As-Built plans and elevations marking out installation and location of renewable energy equipment. Manufacturer's technical specification of the renewable energy equipment. As-Measured kWp or equivalent renewable energy generated. Describe any deviation or addition to the DA submission. DESIGNATION DESIGNATION COMPANY SIGNATURE NAME DESIGNATION COMPANY SIGNATURE

EE5

ADVANCED EE PERFORMANCE – BEI AND/OR EUI

10 POINTS

INTENT

To encourage enhancement of building and industrial plant process EE performance thereby reduce CO₂ emission.

REQUIREMENTS

Demonstrate that Energy Efficiency (EE) performance exceeds the baseline minimum to reduce energy consumption in the building and/or the industrial plant process. For building, improve Building Energy Intensity (BEI) as defined by GBI [use of GBI approved software is permitted]. For industrial plant process, use Energy Use Intensity (EUI) to compare against baseline data for similar plant process [baseline EUI shall be furnished by applicant for GBI acceptance]. Use BEI or EUI if either building or industrial plant process energy use constitutes more than 75% of the total energy use. Otherwise, calculate both BEI and EUI with the lower point score applicable, for award of points as follows:

1 point	where BEI \leq 180 kWh/m2/year or EUI improvement \geq 10%
3 points	where BEI \leq 150 kWh/m2/year or EUI improvement \geq 25%
4 points	where BEI \leq 140 kWh/m2/year or EUI improvement \geq 30%
5 points	where BEI \leq 130 kWh/m2/year or EUI improvement \geq 35%
6 points	where BEI \leq 120 kWh/m2/year or EUI improvement \geq 40%
7 points	where BEI \leq 110 kWh/m2/year or EUI improvement \geq 45%
8 points	where BEI ≤ 100 kWh/m2/year or EUI improvement $\geq 50\%$
10 points	where BEI \leq 90 kWh/m2/year or EUI improvement \geq 55%

APPROACH & IMPLEMENTATION

Cutting edge technologies and materials should be fully explored for application. For passive design applications, consider use of better insulation materials, such as wall insulation of autoclaved lightweight concrete, composite insulated wall, double brickwalls or other options. Glazing should be optimally sized and the use of performance glazing such as low-e and/or spectrally selective glazing is encouraged. Roof insulation should also be properly addressed. For active design applications, consider EE products for all components and educate users on need to reduce plug loads both in procurement policy and usage.

POTENTIAL TECHNOLOGIES & STRATEGIES

Design the building envelope and systems to maximize energy performance. Adopt the most energy efficient design concepts and strategies for both the building and plant process. For plant process, explore opportunities for energy recovery and/or reuse. Quantify BEI and/or EUI performance as compared to a baseline building/plant. Use of appropriate simulation software tools is encouraged.

REC	REQUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)					GBI
1. 2.	, , , , , , , , , , , , , , , , , , , ,					0
REG	QUIRED SU	SUBMITTER	GBI			
1.	Actual ve	rified BEI achieved for compl	eted building.		\circ	\bigcirc
2.	Actual EN	иS printouts.	· ·		\circ	\circ
3.	Describe	any deviation or addition to t	the DA submission.		\circ	\bigcirc
PR	OJECT NAME				DATE	
	SUBMITTING PROFESSIONAL NAME DESIGNATION COMPANY					
CLI	NAME DESIGNATION COMPANY					

EE6 ENHANCED COMMISSIONING 4 POINTS

INTENT

To ensure building and industrial plant process energy related systems are installed to achieve proper commissioning so as to realise their full potential and intent. This will serve to eliminate the bad practice of not fully commissioning the installed systems.

REQUIREMENTS

Appoint an independent GBI recognised Commissioning Specialist (CxS) to ensure comprehensive commissioning is performed for all the building/plant energy related systems in accordance with ASHRAE Commissioning Guideline or other GBI approved equivalent standard/s by:

- Conducting at least one commissioning design review during the detail design stage and back-check the review comments during the tender documentation stage.
- Developing and incorporating commissioning requirements into the tender documents.
- Developing and implementing a commissioning plan.
- Verifying the installation and performance of the system to be commissioned.
- Reviewing contractor submittals applicable to systems being commissioned for compliance.
- Developing a systems manual that provides future operating staff information needed to understand and optimally operate the commissioned systems.
- Verifying that the requirements for training operating personnel, building occupants and plant operators are completed.

APPROACH & IMPLEMENTATION

Appointment of a CxS to provide commissioning advice (including accessibility and maintainability provisions) to the Client and to monitor and verify commissioning of the building and industrial plant process energy related systems.

POTENTIAL TECHNOLOGIES & STRATEGIES

Installation of state-of-the-art measuring devices and sensors compatible with the installed EMS will aid in commissioning and also enhance EE.

REC	DUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Confirmation letter from the CxS of his appointment and scope of works in accordance with the GBI CxS requirements.	0	0
REC	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	Documentary evidence that the full scope of CxS works have been carried out during the contract administration phase.	0	\circ
2.	The final commissioning report including recommendations to the client regarding the performance of the commissioned building energy related systems.	\circ	0
3.	A copy of the systems manual as described in the CxS scope of works.	\circ	\bigcirc
4.	Documented evidence of training of building management staff.	\circ	\bigcirc
5.	Describe any deviation or addition to the DA submission.	0	0

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

EE7

ON-GOING POST OCCUPANCY COMMISSIONING

2 POINTS

INTENT

To ensure up-to-date on-going post occupancy/post plant operation commissioning are carried out for all tenancy fit-out and plant modification changes are completed.

REQUIREMENTS

- **1 point:** Awarded where professional engineer/specialist reviews all tenancy fit-out plans / plant modification to ensure original design intent is not compromised and upon completion of the fit-out / plant modification works, verify and fine-tune the installations to suit.
- **1 point:** Awarded where the CxS carries out a full post/re-commissioning of the energy related systems to verify that their performance is sustained in conjunction with the completed tenancy fit-outs / plant modifications within 12 months of practical completion (or earlier if there is at least 50% occupancy/plant operation).

APPROACH & IMPLEMENTATION

Professional engineer/specialist must check all fit-out designs and plant modifications. The CxS shall carry out the post occupancy commissioning for all tenancy areas after fit-out changes / plant modification changes are completed.

RE	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Declaration that post occupancy/modification commissioning will be undertaken.	0	0
RE	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

INTENT

To verify predicted energy use of key building services and industrial plant process.

REQUIREMENTS

- **1 point:** Awarded for the use of Energy Management System to monitor and analyse energy consumption including reading of sub-meters, **AND**
- **1 point:** Fully commission EMS including Maximum Demand Limiting programme within 12 months of practical completion (or earlier if there is at least 50% building occupancy and plant operation).

APPROACH & IMPLEMENTATION

Fully commission the maximum demand limiting programme and utilise EMS to monitor energy consumption.

RE	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Declaration of commitment to carry out EE verification upon completion.	0	0
RE	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	Actual verified BEI/EUI achieved, Renewable Energy generated and Water consumption for completed building/plant.	0	\circ
2.	Where EMS is installed, comprehensive printouts of EMS results including Maximum Demand Limiting program setting.	\circ	0
3.	Describe any deviation or addition to the DA submission.	\circ	\bigcirc

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

EE9 SUSTAINABLE MAINTENANCE 2 POINTS

INTENT

To ensure the energy related systems will continue to perform as intended beyond 12 months Defects & Liability period.

REQUIREMENTS

1 point : Awarded where at least 50% of permanent maintenance team to be on-board one (1) to three (3) months before practical completion and to fully participate (to be specified in contract conditions) in the Testing & Commissioning of all energy services, *AND*

Set up a permanent Energy Monitoring Committee (EMC) to ensure that plant energy performance is continuously monitored and improved.

1 point : Awarded for providing a designated facility maintenance office that is fully equipped with facilities (including tools and instrumentation) and inventory storage, **AND**

Provide evidence of documented plan for at least 3-year facility maintenance and preventive maintenance budget (inclusive of staffing and outsourced contracts).

APPROACH & IMPLEMENTATION

Ensure the maintenance team fully participates in the testing and commissioning stage, understand the design intent and provide a 3-year sustainable maintenance program.

REC	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Identify building maintenance room and facilities in the design floor plan.	0	0
2.	Commitment to deploy at least 50% of permanent maintenance team to be on-board one (1) to three (3) months before practical completion and to fully participate in the Testing & Commissioning of all energy services with organisation chart and staff positions identified.	0	0
3.	Commitment to provide evidence of documented plan for at least 3-year facility maintenance and preventive maintenance budget (inclusive of staffing and outsourced contracts).	0	0
REC	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	Documentary evidence that 50% of the maintenance team were involved in the full testing & commissioning of the building / plant process energy related systems.	0	0
2.	Comprehensive list of maintenance tools and instrumentation, and inventory storage items.	0	0
3.	Provide evidence of documented plan for at least 3-year facility maintenance and preventive maintenance budget for facility maintenance (inclusive of staffing and outsourced contracts).	0	0
4.	Describe any deviation or addition to the DA submission.	\circ	\circ

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

NOTE ATTACH ALL SUBMITTALS WITH THIS COVER PAGE

VERSION 1.02 | MARCH 2019

INDOOR ENVIRONMENTAL QUALITY (EQ)

EQ1	MINIMUM IAQ PERFORMANCE	1 POINT

INTENT

To provide for minimum IAQ performance in building and plant to ensure comfort and well-being of occupants.

DESCRIPTION

Design provision to meet the minimum requirements of ventilation rate in ASHRAE 62.1 or local building code, whichever is the more stringent.

REQUIREMENTS

Meet the minimum requirements specified in ASHRAE 62.1 or local building code whichever is stricter.

APPROACH & IMPLEMENTATION

Designing ventilation system to meet the minimum requirement specified in ASHRAE 62.1 ensures adequate fresh air is available to occupants in the space. The Ventilation Rate Procedure or the Indoor Air Quality Procedures can be used to determine the minimum required ventilation rates for various applications. Ventilation Rate Procedure is more straightforward to apply. The IAQ Procedure of ASHRAE 62.1 is a performance-based procedure that addresses designing the ventilation system to maintain acceptable levels of known contaminants.

REC	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Description of the ventilation design.	\circ	\circ
2.	Schematic to illustrate the ventilation system design.	\circ	\circ
3.	Summary table with calculations to illustrate how the delivered minimum outdoor airflow to each zone and the outdoor air intake for the system meet the requirements of ASHRAE and/or local code.	0	0
	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	As-Built drawings to illustrate the ventilation system design.	\circ	\circ
2.	Summary report to describe the ventilation design and how it complies with ASHRAE 62.1 and/or the local code including information regarding the fresh air intake volumes and any special conditions that affect the ventilation design.	0	0
3.	Detailed calculations or simulations to show how the delivered minimum outdoor airflow to each zone and outdoor airflow air intake for the system meet the requirements in ASHRAE and/or local code.	0	0
4.	Describe any deviation or addition to the DA submission.	\circ	\circ

PROJECT NAME			DATE	
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

EQ2

ENVIRONMENTAL TOBACCO SMOKE (ETS) CONTROL

1 POINT

INTENT

To minimize exposure of building and plant occupants to Environmental Tobacco Smoke.

DESCRIPTION

Avoid health problems associated with tobacco smoke by preventing possible contamination in the building and plant, thereby reducing health risks to occupants linked to "second-hand smoke".

REQUIREMENTS

Prohibit smoking in the building and plant area; and locate any exterior designated smoking areas at least 10m away from entries, outdoor air intakes and operable windows, **OR**

Prohibit smoking in the building and plant area except in designated smoking room, and establish negative pressure in the smoking rooms together with provision of effective air filtration system.

APPROACH & IMPLEMENTATION

Prohibition of smoking in air-conditioned public building is already mandatory under Malaysian Law. This credit can be achieved by strictly enforcing prohibition of smoking in the premises, through supervision or signage. If designated smoking areas are provided outside the premises, ensure that the tobacco smoke does not enter the rest of the premises or the ventilation system.

REC	UIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Description of strategies to be employed in the premises to achieve this credit (by means of management policy or signage proposal).	0	\circ
2.	Plans showing the location of exterior and/or interior designated smoking areas, if any.	\circ	\circ
REC	UIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	As-Built drawings identifying location of exterior and/or interior designated smoking areas	\circ	\circ
2.	Summary report describing strategies undertaken to ensure prohibition of smoking indoors can be enforced and strategies implemented to ensure that tobacco smoke will not enter the premises or ventilation system where exterior and/or interior smoking area is provided.	0	0
3.	Photographic evidence of strategies adopted.	\bigcirc	\circ
4.	Describe any deviation or addition to the DA submission.	\circ	\circ

PROJECT NAME	ROJECT NAME			DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

NOTE ATTACH ALL SUBMITTALS WITH THIS COVER PAGE

30

EQ3

CARBON DIOXIDE MONITORING AND CONTROL

1 POINT

INTENT

To provide capacity for effective ventilation system monitoring and control so as to ensure comfort and well-being of building and plant occupants.

DESCRIPTION

Use carbon dioxide monitoring and control system to deliver the required outdoor air to the occupants to suit variation in occupancy.

REQUIREMENTS

Install carbon dioxide (CO_2) monitoring and control system with at least one (1) CO_2 sensor at main return air points on each floor to facilitate continuous monitoring and adjustment of outside air ventilation rates to each floor, and ensure independent control of ventilation rates to maintain CO_2 level < 1,000 ppm.

APPROACH & IMPLEMENTATION

Use of carbon dioxide monitoring system is a typical energy conservation measure to ensure different spaces receive adequate outdoor air for their current occupancy and the ventilation system can adjust the ventilation rate to meet changing requirements. This helps to ensure occupants will receive adequate outdoor air at all times.

REC	UIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Submission of ventilation and control schematics together with description of how ${\rm CO_2}$ monitoring and controls are integrated into the ventilation design.	0	0
REC	UIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	As-Built drawings showing the installed sensors and controls.	\circ	\circ
2.	Summary report on the ventilation design and ${\rm CO_2}$ monitoring and control system including information regarding the location, quantity of installed sensors, the operational parameters and set points.	0	0
3.	Manufacturer's information confirming the specifications of the ${\rm CO_2}$ sensors.	\circ	\bigcirc
4.	Photographic evidence of typical installations.	\circ	\bigcirc
5.	Describe any deviation or addition to the DA submission.	\bigcirc	\circ

PROJECT NAME	ROJECT NAME			DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

EQ4

INDOOR AIR POLLUTANTS & INDUSTRIAL CHEMICAL EXPOSURE

3 POINTS

INTENT

To minimize detrimental impact on occupants' health from finishes that emits internal air pollutants and exposure to industrial chemicals.

DESCRIPTION

Encourage the use and specification of healthy materials and finishes which contain low volatile organic compounds (VOC) and formaldehyde.

REQUIREMENTS

1 point: Use low VOC paint and coating throughout the building and plant area. Paints and Coatings to comply with requirements specified in international labelling schemes recognized by GBI, **AND**

Use low VOC carpet or flooring throughout the building. Carpets to comply with requirements specified in international labelling schemes recognized by GBI. Other types of flooring to comply with requirements under FloorScore developed by Science Certification System or equivalent, **AND**

Use low VOC adhesive and sealant or no adhesive or sealant used.

- 1 point: Use products with no added urea formaldehyde. These include:
 - Composite wood and agrifiber products defined as: particleboard, medium density fibreboard (MDF), plywood, wheatboard, strawboard, panel substrates and door cores, AND
 - 2. Laminating adhesives used to fabricate on-site and shop-applied composite wood and agrifiber assemblies, **AND**
 - 3. Insulation foam, AND
 - 4. Draperies.

1 point : Minimise air pollutants from building and plant by using environmental friendly house keeping chemicals and minimise microbial contamination and NOX emission.

APPROACH & IMPLEMENTATION

The credit requirements should be clearly stated in project specifications. Provide cut-sheets, material safety data sheets, certificates and test reports. Submittal of the compliance documentation is a pre-requisite for product approval.

RE	REQUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)				GBI
1.	Summary report identifying areas whe credit compliance is to be met.	re the low VOC ma	aterials will be installed and how t	he 🔘	0
RE	QUIRED SUBMISSION FOR COMPLETION	N & VERIFICATION	ASSESSMENT (CVA)	SUBMITTER	GBI
1.	As-Built drawings showing where low	VOC materials or	products are used.	\circ	\circ
2.	List of products installed that meet th	e credit requireme	ents, and their specifications.	\circ	\circ
3.	. Manufacturer's information including data sheets, certificates, test reports etc to demonstrate credit compliance.			ite 🔘	\circ
4.	Photographic evidence of each typica	al low VOC installa	tion.	\circ	\circ
5.	Describe any deviation or addition to	the DA submissio	n.	\circ	0
PR	DJECT NAME			DATE	
	NAME	DESIGNATION	COMPANY	SIGNATURE	

NOTE ATTACH ALL SUBMITTALS WITH THIS COVER PAGE

COMPANY

DESIGNATION

NAME

SUBMITTING PROFESSIONAL

CLIENT

SIGNATURE

EQ5 MOULD PREVENTION 1 POINT

INTENT

To prevent microbial contamination in the building and plant area to ensure the health and well-being of occupants.

DESCRIPTION

Design system(s) which reduce the risk of mould growth and its associated detrimental impact on occupant health.

REQUIREMENTS

Demonstrate that the air-conditioning and mechanical ventilation system will maintain a positive indoor air pressure relative to the exterior, and can actively control indoor air humidity to be no more than 70% RH without the use of active control that will consume additional energy.

Ensure that excessive moisture in building and plant area is controlled during the Design, Construction and Operation stages by the consideration and the control of the following:

- Rainwater leakage through roof and walls
- Infiltration of moist air
- Diffusion of moisture through walls, roof and floors
- Groundwater intrusion into basements and crawl spaces through walls and floors
- Leaking or burst pipes
- Indoor moisture sources
- Construction moisture

OR

The above mentioned measures are not necessary or applicable for any part of the building or plant area that is not airconditioned.

APPROACH & IMPLEMENTATION

The most effective way to control indoor mould growth is through elimination of moisture. It is important to dry water damaged areas and items within 24 to 48 hours to prevent mould growth. Humidity in spaces and ductwork has to be controlled throughout construction and occupation of the premises.

REC	EQUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)					GBI
1.	Summary	report outlining the strategie	s adopted to meet the o	credit requirements.	\circ	\circ
2.	A copy of	specifications for the strateg	ies to be carried out.		\circ	\bigcirc
REC	EQUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)					GBI
1.	As-Built drawings or As-Built specifications confirming that the industrial building has bee constructed in accordance with the strategies adopted.					0
2.	Manufacturer's information on all relevant materials specified for mould prevention and/resistance, to verify credit compliance.				\circ	0
3.	•					0
4.		24-hour record (during ful nents for at least two (2) areas			\circ	0
5.	Describe	any deviation or addition to t	he DA submission.		\circ	\bigcirc
PRO	JECT NAME				DATE	
SUBMITTING PROFESSIONAL NAME DESIGNATION COMPANY S					SIGNATURE	
CLI	ENT	NAME	DESIGNATION	COMPANY	SIGNATURE	

NOTE ATTACH ALL SUBMITTALS WITH THIS COVER PAGE

33

EQ6

THERMAL COMFORT: DESIGN & CONTROLLABILITY OF SYSTEMS

2 POINTS

INTENT

To provide a thermal environment that is comfortable and supports the productivity and well-being of building and plant occupants.

DESCRIPTION

Provide a high level of thermal comfort system control by individual occupant or by specific groups in multi-occupant spaces to promote the productivity, comfort and well-being of occupants.

REQUIREMENTS

- **1 point:** Provide a high level of thermal comfort system control by individual occupant or by specific groups in multi-occupant spaces to promote the productivity, comfort and well-being of occupants. Design to ASHRAE 55 in conjunction with the relevant localised parameters as listed in MS1525.
- **1 point:** Provide individual comfort control for $\geq 50\%$ of the occupants to enable adjustments to suit individual task needs and preferences, **AND**

Provide comfort system control for all shared multi-occupant spaces to enable adjustments to suit group needs and preferences, \boldsymbol{AND}

Conditions for thermal comfort include the primary factors of air temperature, radiant temperature, air speed and humidity. Comfort system control for this purpose is defined as the provision of control over at least one of these primary factors in the occupants' local environment.

APPROACH & IMPLEMENTATION

Conditions for thermal comfort include the primary factors of air temperature, radiant temperature, air speed and humidity. Comfort system control for this purpose is defined as the provision of control over at least one of these primary factors in the occupants' local environment.

REC	REQUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)					GBI
1.	Describe how the project will fulfil the requirements on provision of individual control for at least 50% of occupants and also provision of controls for shared multi-occupant spaces.			0	0	
REC	QUIRED SU	SUBMITTER	GBI			
1.	Summary report that includes information on the methods used to establish thermal conditions for the project and how the system design addresses the design criteria.				0	\circ
2.	Provide 72-hour record (during full occupancy) of temperature measurement for at least two (2) areas acceptable to the GBI Certifier, to verify the specified close thermal comfort condition.					0
3.	Summary report on the individual types of control and the controls for multi-occupant spaces that are provided to achieve the credit compliance.				\circ	0
4.	Photogra	phic evidence of each typical	type of sensor and cont	trol installed.	\circ	\circ
5.	Describe	any deviation or addition to t	he DA submission		\bigcirc	\bigcirc
PRO	PROJECT NAME DATE					
	NAME DESIGNATION COMPANY SI				SIGNATURE	
	SUBMITTING PROFESSIONAL					
21.1	NAME DESIGNATION COMPANY SIG				SIGNATURE	

EQ7 AIR-CHANGE EFFECTIVENESS 1 POINT

INTENT

To ensure effective delivery of clean air through reduced mixing with indoor pollutants in order to promote a healthy indoor environment

DESCRIPTION

Prevent or minimize short-circuiting of outdoor ventilation air through recirculation of supply and return air.

REQUIREMENTS

Demonstrate that the Air Change Effectiveness (ACE) meets the following criteria for at least 90% of the NLA (air-conditioned areas only):

The ventilation system is designed to achieve an ACE \geq 0.95 when measured in accordance with ASHRAE 129. Measure air change effectiveness, where ACE is to be measured within the breathing zone (nominally 1.0m from finished floor level).

APPROACH & IMPLEMENTATION

Compliance may be met either through measurement of the completed building in accordance to ASHRAE 129 or equivalent or using CFD simulations or implementation of accepted airside design strategy such as UFAD (Under Floor Air Distribution), LLD (Low Level Displacement), personalised ventilation system, etc.

RE	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Summary report detailing the design criteria that has been adopted for each type of space in the development.	\circ	0
2.	Describe how the ventilation system meets the credit compliance.	0	0
RE	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	As-Built drawings to show the ventilation system.	\circ	\bigcirc
2.	Summary report detailing the ventilation design criteria adopted for each type of space in	\bigcirc	_
	the building.	O	O
3.	the building. Record of measurement to demonstrate compliance of this credit requirement.	0	0

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

NOTE ATTACH ALL SUBMITTALS WITH THIS COVER PAGE

35

EQ8 BREAKOUT SPACES 1	POINT
-----------------------	-------

INTENT

To reduce worker's fatigue.

DESCRIPTION

Provide breakout space to reduce worker's fatigue for at least 5% of employees per shift.

REQUIREMENTS

Provide breakout space to reduce worker's fatigue for at least 5% of employees per shift.

REQUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)			GBI
1.	Plans and elevations marking out areas for breakout spaces.	0	0
2.	Description of strategies to be employed in the building to achieve this credit (by means of management policy or signage proposal).	0	0
REC	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
REC	As-Built drawings identifying location of breakout spaces.	SUBMITTER	GBI
	•	SUBMITTER	GBI
1.	As-Built drawings identifying location of breakout spaces.	SUBMITTER	GBI

PROJECT NAME	DATE			
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

EQ9	DAYLIGHTING	2 POINTS

INTENT

To ensure provision of good levels of daylighting for building and plant occupants.

DESCRIPTION

Provide good level of diffused daylight into interior of building and plant.

REQUIREMENTS

1 point: Demonstrate that $\geq 30\%$ of the NLA has a Daylight Factor in the range of 1.0 – 3.5% as measured at the working plane, 800mm from floor level, **OR**

2 points: Demonstrate that \geq 50% of the NLA has a Daylight Factor in the range of 1.0 – 3.5% as measured at the working plane, 800mm from floor level.

Note: Refer to MS1525 for the description and calculation of Daylight Factor.

APPROACH & IMPLEMENTATION

Daylight system for building includes window, façade shading/light deflecting devices (e.g. lightshelves), roof lights and atrium spaces. The Daylight Factor is the ratio of indoor light level measured on the working plane to the outdoor light level during overcast conditions with no direct sun. For a daylit space, to ensure visual comfort, the lighting level should be fairly uniform with no great contrast.

REQ	UIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Summary report with diagrams, of the design daylight strategies including for glare control that will be undertaken to meet the credit requirements.	0	0
REQ	UIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	As-Built drawings and specifications demonstrating that the daylighting system has been constructed according to design drawings/specifications. Typical As-Built floor plans and sections showing position of glare control system.	0	0
2.	Typical floor plans with Daylight Factor measurement results.	\bigcirc	\bigcirc
3.	Site plan incorporating height of existing buildings or planned buildings surrounding the building together with solar diagrams & sun path.	\circ	0
4.	Summary of Daylight Factor results.	\circ	\circ
5.	Manufacturer's Information on the daylighting system used, if custom-made.	\bigcirc	\bigcirc
6.	Furnish photographs of each type of typical device installed.	\bigcirc	\bigcirc
7.	Describe any deviation or addition to the DA submission.	\bigcirc	\bigcirc

PROJECT NAME	DATE			
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

EQ10 DAYLIGHT GLARE CONTROL 1 POINT

INTENT

To reduce discomfort of glare from natural light.

DESCRIPTION

Ensure daylighting system is designed with adequate and proper glare control in order not to negate the benefits of daylighting.

REQUIREMENTS

Where blinds or screens are fitted on glazing and atrium as a base building, incorporate provisions to meet the following criteria:

- 1. Eliminate glare from all direct sun penetration and keep horizontal workspace luminance level below 2000 lux;
- 2. Eliminate glare from diffused sky radiation for occupant workspace at viewing angles of 15° to 60° from the horizontal at eye level (typically 1.2m from floor level);
- 3. Control with an automatic monitoring system (for atrium and windows with incident direct sun light only not applicable for fixed blinds/screens); **AND**
- 4. Equip with a manual override function accessible by occupants (not applicable for fixed blinds/screens).

APPROACH & IMPLEMENTATION

Glare issues typically arise during periods of low angle sun (early mornings and late afternoons) and during periods with bright sky. Glare control should therefore be designed to ensure both a view out and some level of daylight when the systems are engaged.

KEC	SOIKED 30	BMISSION FOR DESIGN ASSE	SSMENT (DA)		SUBMITTER	GBI
1.	Typical flo	oor plans and sections showin	g variable position of gl	are control system.	0	0
2.	Brief des	cription of proposed control r	nechanism to be provide	ed.	\circ	\circ
3.	,	report to describe how view	and daylight is assured	d when glare control system	\circ	\circ
	is engage	ed.				
REC	UIRED SU	BMISSION FOR COMPLETION	& VERIFICATION ASSES	SSMENT (CVA)	SUBMITTER	GBI
1.		drawings and specifications to rawing and specifications.	o confirm that building	is constructed according to	0	0
2.	Typical A	s-Built floor plans and section	s showing position of gl	are control system.	\bigcirc	\bigcirc
3.	Descripti	on of control mechanism insta		\bigcirc	\bigcirc	
4.	Manufact	urer's Information on the blind and control systems provided.			\bigcirc	\bigcirc
5.	Summary is engage	report to describe how viewed.	0	0		
6.	Furnish p	hotographs of each type of ty	pical glared control syst	tem installed.	\circ	\bigcirc
7.	Describe	any deviation or addition to t	he DA submission.		\bigcirc	\bigcirc
					DATE	
PRO	DJECT NAME				DATE	
SUI	BMITTING	NAME	DESIGNATION	COMPANY	SIGNATURE	
	DFESSIONAL				l	
		NAME	DESIGNATION	COMPANY	SIGNATURE	
CLI	ENT					

EQ11	ELECTRIC LIGHTING LEVELS	1 POINT

INTENT

To ensure lighting level is not over-designed.

DESCRIPTION

Ensure lighting level is designed in accordance to MS1525 for different types of spaces.

REQUIREMENTS

Demonstrate that lighting design maintains a luminance level of no more than specified in MS1525 for 90% of NLA (building and industrial plant area) as measured at the working plane (800 mm above the floor level).

APPROACH & IMPLEMENTATION

The ambient lighting level should be designed in accordance with the luminance level recommended in MS1525. Task lighting may be provided for occupants who require a higher lighting level either for their own preference or for various task needs.

REC	DUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Summary report of lighting design brief to illustrate how the credit will be met.	0	0
REC	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	As-Built drawings showing the lighting layout plans.	\circ	\bigcirc
2.	Photometric measurements to illustrate that the lighting level fulfils the credit requirement.	\bigcirc	\bigcirc
3.	Furnish photographs of typical floor lighting installation.	\bigcirc	\bigcirc
4.	Describe any deviation or addition to the DA submission.	\circ	\bigcirc

PROJECT NAME		DATE		
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

EQ12	HIGH FREQUENCY BALLASTS	1 POINT
EQ12	HIGH FREQUENCY BALLASTS	1 POINT

INTENT

To provide for comfortable visual working environment for occupants.

DESCRIPTION

Provision of view to the outside for building occupants to achieve benefits of connectivity with the outdoor Increase workplace comfort by avoiding low frequency flickers that may be associated with fluorescent light fittings.

REQUIREMENTS

Install high frequency ballasts in fluorescent luminaires over a minimum of 90% of NLA (building and plant area).

APPROACH & IMPLEMENTATION

Specify high frequency ballasts in fluorescent luminaires. The use of high frequency ballasts in the range of 20kHz and higher will provide smoother, non-flickering lamp operation. At this frequency, the flicker is totally undetectable to the human eye and sensory faculty.

REC	UIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Description of design strategy to achieve installation of high frequency ballasts for minimum 90% of NLA	0	0
REC	UIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	As-Built lighting plans to identify location of the 90% NLA of fluorescent luminaries installed with high frequency ballasts.	0	0
2.	Manufacturer's information confirming the specifications of high frequency ballasts installed.	0	\circ
3.	Describe any deviation or addition to the DA submission.	\circ	0

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

NOTE ATTACH ALL SUBMITTALS WITH THIS COVER PAGE

40

EQ13	EXTERNAL VIEWS	2 POINTS

INTENT

To reduce eyestrain for building occupants by providing long distance views and visual connection to the outdoor.

DESCRIPTION

Provision of view to the outside for building occupants to achieve benefits of connectivity with the outdoor environment.

REQUIREMENTS

1 point: Demonstrating that \geq 60% of the NLA has a direct line of sight through vision glazing at a height of 1.2m from floor level, *OR*

2 points: Demonstrating that \geq 75% of the NLA has a direct line of sight through vision glazing at a height of 1.2m from floor level.

APPROACH & IMPLEMENTATION

Column free spaces and low interior partitions should be designed if possible. Offices should locate open plan areas along the perimeter of the façade, while private offices and areas not regularly occupied should be placed at the core of the building. Maintaining the views for spaces near the core is the primary design objective.

RE	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Typical floor plans to identify how external view for the spaces is maintained.	\circ	\circ
2.	Design strategy of the interior layout that will be designed or recommended to maintain view to the outside.	0	0
RE	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	As-Built plans including interior layout confirming that there is direct line of sight to outside through vision glazing between 0.8 and 2.2m above the finish floor level for the required spaces.	0	0
2.	For buildings where fit-out is not done, recommended interior layout shall be provided to tenants.	\circ	0
3.	Describe any deviation or addition to the DA submission.	\circ	\bigcirc

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

EQ14	INTERNAL NOISE LEVELS	1 POINT

INTENT

To ensure building is designed to maintain a comfortable acoustic environment for occupants.

DESCRIPTION

Maintain internal noise level at an acceptable and tolerable level.

REQUIREMENTS

Demonstrate that 90% of the NLA (office component only) do not exceed the following ambient internal noise level:

- Within the entire building general office, space noise does not exceed 40 dBAeq, OR
- Within the baseline building office space, the sound level does not exceed 45 dBAeq for open plan and does not
 exceed 40 dBAeq for closed offices.

APPROACH & IMPLEMENTATION

Excessive noise can cause discomfort to occupants. Some of the solutions to ensure acceptable noise level is maintained include:

- Specify internal acoustics lining up to 5-10m of the AHU discharge duct
- Specify use of duct silencers or sound attenuators
- Specify acoustical ceiling
- Specify furniture with sound absorbing surfaces on both sides
- Locate photocopiers, fax machines away from the main office areas in a separate area
- Insulate partition cavities
- Mechanical equipment room to be located away from office and conference rooms

REC	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Design report on strategies to ensure internal noise level is maintained at the prescribed levels.	0	0
2.	Floor plans showing location of Core, M&E, and equipment rooms.	\circ	0
REC	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	Report describing the measured internal and external noise sources and features installed to achieve required noise level.	\circ	0
2.	As-Built drawings showing noise control features.	\circ	\bigcirc
3.	Manufacturer's data sheets of the acoustic materials used in building.	\bigcirc	\bigcirc
4.	Describe any deviation or addition to the DA submission.	\bigcirc	\bigcirc

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

EQ15 IAQ BEFORE & DURING OCCUPANCY 2 POINTS

INTENT

To maintain good Indoor Air Quality condition both before building/plant occupancy and during occupancy.

DESCRIPTION

Reduce indoor air quality problems resulting from the construction process in order to help sustain the comfort and well-being of occupants/workers.

REQUIREMENTS

1 Point: Develop and implement an Indoor Air Quality (IAQ) Management Plan for the Pre-Occupancy phase as follows:

Option 1: Perform a building flush-out by supplying outdoor air to provide not less than 10 air changes/hour (ACH) for at least 30 minutes operation before occupancy and continuous minimum 1 ACH during the initial 14 days occupancy of the completed building/plant, *OR*

Option 2: If low VOC materials and low formaldehyde composite wood are used, then building/plant flush-out can be performed by supplying outdoor air to provide not less than 10 ACH for at least 15 minutes operation or not less than 6 ACH for at least 30 minutes operation and continuous 1 ACH during the initial 7 days occupancy of the completed building/plant, **OR**

Option 3: Conduct IAQ testing to demonstrate maximum concentrations of pollutants do not exceed that listed in the Indoor Air Quality Code of Malaysia within 12 months of occupancy.

1 Point: During Occupancy Stage:

Where a permanent air flushing system of at least 10 airchanges/hour operation is installed for use during occupancy stage.

APPROACH & IMPLEMENTATION

Options 1 and 2, flush-out procedure may begin once all fit-out work is completed. As the purpose of flushing out is to evacuate air-borne contaminants in the building, the most effective way is to use non-polluting interior materials as a source control.

Option 3, IAQ testing procedure to confirm major contaminants are below recognized acceptable levels. This will help to ensure good indoor air quality for occupants.

REC	REQUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)				SUBMITTER	GBI
1.	Summary requirem	ary report outlining the strategies and procedures to be taken to meet the credit ements.				0
REC	UIRED SU	BMISSION FOR COMPLETION	& VERIFICATION ASSES	SSMENT (CVA)	SUBMITTER	GBI
1.	Report or	n flush-out procedure includir	ng the actual dates of the	e flush-out.	\circ	\circ
2.	2. If IAQ testing is carried out, a report to outline the procedures undertaken and the results of the testing to verify if the credit requirements are met or not. If not, corrective measures must be taken.			_	0	
3. Describe any deviation or addition to the DA submission.					0	0
PRO	JECT NAME				DATE	
SUBMITTING PROFESSIONAL NAME DESIGNATION COMPANY SIGN					SIGNATURE	
CLI	ENT	NAME	DESIGNATION	COMPANY	SIGNATURE	

EQ16

POST OCCUPANCY COMFORT SURVEY: VERIFICATION

1 POINT

INTENT

To provide for assessment of comfort of the building occupants/plant workers.

DESCRIPTION

Conduct post occupancy comfort survey of building occupants/plant workers and to undertake measures to rectify the problems identified during the survey.

REQUIREMENTS

- Conduct an occupancy comfort survey of occupants/workers annually. This survey should collect anonymous responses
 about thermal comfort, visual comfort and acoustic comfort in a building/plant. It should include an assessment of
 overall satisfaction with thermal, visual and acoustic performance and identification of thermal-related, visual-related
 and acoustic-related problems, AND
- 2) Develop a plan for corrective action if the survey results indicate that more than 20% of occupants/workers are dissatisfied with the overall comfort in the building. This plan should include measurement of relevant environmental variables in problem areas. The relevant environmental variables include 1) temperature, relative humidity, air speed and mean radiant temperature, 2) lighting level and glare problem, 3) background noise level, 4) odour problem, CO2 level, VOCs, and particulate concentration.

APPROACH & IMPLEMENTATION

Provide a systematic process and system for occupants to provide feedback on their indoor environmental comfort. The survey should collect responses from a significant and representative sample of occupants. The subjective survey should be accompanied with objective measurements of the relevant environmental variables. Short term monitoring or spot measurements should be done once problem areas have been identified through the survey. Corrective actions should then be undertaken to rectify the problem areas identified to improve the indoor environmental conditions of the occupants.

REC	REQUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)		
1.	Summary report of the strategies that will be undertaken to meet the credit compliance.	0	0
REC	DUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	Survey questionnaire used to collect responses from the occupants.	\circ	\circ
2.	Objective measurement plan illustrating the areas and measurements undertaken.	\bigcirc	\circ
3.	Analysis report of the results of the survey and measurements.	\circ	\circ
4.	Corrective action plan and measures undertaken to rectify the problem.	\circ	\circ
5.	Describe any deviation or addition to the DA submission.	\circ	0

PROJECT NAME			DATE	
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

SUSTAINABLE SITE PLANNING & MANAGEMENT (SM)

SM1 SITE SELECTION 1 POINT

INTENT

To avoid development of inappropriate sites and to reduce environmental impact from the location of the building/plant.

DESCRIPTION

Minimize ecological damage to existing natural features, water bodies, flora and fauna.

REQUIREMENTS

Do not develop building/plant, hardscape, road or parking area on a site or part of a site that meets any one of the following criteria:

- 1. Prime farmland as defined by the Structure Plan for the area or the National Physical Plan.
- 2. Forest reserve or State Environmental Protection Zone that is specifically identified as habitat for endangered species.
- 3. Within 30m of any wetlands as defined by the Structure Plan of the area OR within setback distances from wetlands prescribed in state or local regulations, as defined by local or state rule or law, whichever is the more stringent.
- 4. Previously undeveloped land that is within 30m of Mean High Water Spring (MHWS) sea level which supports or could support wildlife or recreational use, or statutory requirements whichever is more stringent.
- 5. Previously undeveloped land that is within 20m of lake, river, stream and tributary which support or could support wildlife or recreational use.
- 6. Land which prior to acquisition for the project was public parkland, unless land of equal or greater value as parkland is provided.

APPROACH & IMPLEMENTATION

During site selection process, give preference to sites that have low ecological value or are not environmentally sensitive. If unavoidable, locate the building in a suitable location and with a minimal footprint so as to minimize disruption of environmentally sensitive areas.

RE	EQUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)		GBI
1.	Survey plan and Site plan showing footprint of building/plant and its setback dimensions in relationship to existing natural features such as lakes, river, streams, tributaries, beaches, etc. Recommended scale 1:500.	0	0
RE	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
RE	As-Built site plans showing footprint of building/plant and dimensions in relationship to existing natural features such as lakes, rivers, streams, tributaries, beaches, etc. Recommended scale 1:500.	SUBMITTER	GBI

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL				
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

SM2	BROWNFIELD REDEVELOPMENT	1 POINT
-----	--------------------------	---------

INTENT

To redevelop and rehabilitate existing damaged or used site which is complicated by environmental contamination. This serves to channel development to brownfield sites thereby reducing pressure on greenfield sites.

DESCRIPTION

Existing damaged or contaminated sites are typically old industrial sites, old rubbish dumpsites, former mining land, former petrol stations, etc., where contaminating industrial activities had taken place.

REQUIREMENTS

Reduce pressure on undeveloped land by rehabilitating damaged site where development is complicated by environmental contamination, thereby reducing pressure on undeveloped land.

APPROACH & IMPLEMENTATION

Conduct a soil condition test to determine the level of contamination.

REC	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Submit a brief historical report on the usage of the land and prepare a report on the level of contamination certified by an approved testing laboratory.	0	0
2.	Submit an EIA report containing on the level of contamination and proposed mitigating action to be taken, such as the removal, remediation and replacement of contaminated soil/matter, and other actions deemed appropriate.	0	0
REC	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	Submit a report and photographs of works carried out during decontamination process.	\circ	\circ
2.	Describe any deviation or addition to the DA submission.	\bigcirc	\circ

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

SM3

DEVELOPMENT DENSITY & COMMUNITY CONNECTIVITY

2 POINTS

INTENT

Channel development to urban area with existing infrastructure, protect greenfield and preserve habitat and natural

DESCRIPTION

A higher density development or redevelopment will help minimise opening up new greenfield sites, to preserve existing habitat and natural resources, and minimise the use of private mode of transportation.

REQUIREMENTS

1 point: Development Density

Construct building/plant on previously developed site AND in a community with a minimum density of 20,300m2 per hectare net (87,000 sqft per acre net); OR within approved industrial zones.

1 point: Community Connectivity

Construct a new building/plant or renovate an existing building/plant on a previously developed site AND within 1km of a residential zone or neighbourhood with an average density of 25 units per hectare net (10 units per acre net) AND within 1km of at least 10 Basic Services AND with pedestrian access between the building/plant and the services.

Basic Services include, but are not limited to:

- Bank
 Place of Worship
 Convenience/Grocery
 Day Care
 Police Station
 Beauty
 Hardware
 Laundry
 Post Office
 Restaurant
 School
 Fire Station
 Senior Care facility
 Supermarket

- Beauty
- Park

- Theatre
- Community Centre
- Fitness Centre

APPROACH & IMPLEMENTATION

During site selection process, give preference to sites that are within an urban area, where existing infrastructure is available.

KE	JUIKED 30	BMISSION FOR DESIGN ASSE	SSMENT (DA)		SUBMITTER	GBI
1.	Submit Gross Floor Area calculations and density calculations.					\circ
2.		e that the density calculation on a typical four-storey town o	0	\circ		
3.	indicating	showing building/plant loc g covered walkways, pedestria und links. Provide legend for	an access and other con			0
4.	-	is determined by drawing a map and counting the service			0	0
REC	QUIRED SU	BMISSION FOR COMPLETION	& VERIFICATION ASSES	SSMENT (CVA)	SUBMITTER	GBI
1.	Final As-I	Built density calculations.			\circ	\circ
2.		Site plan showing locations of and other connections like link l		3 1	0	\circ
3.	Provide l	egend colours to differentiate	the types of services.		\bigcirc	\bigcirc
4.	Describe	any deviation or addition to t	he DA submission.		\circ	\circ
PR	OJECT NAME				DATE	
	SUBMITTING PROFESSIONAL DESIGNATION COMPANY				SIGNATURE	
CLI	NAME DESIGNATION COMPANY				SIGNATURE	

SM4 ENVIRONMENT MANAGEMENT 2 POINTS

INTENT

To conserve existing natural area and restore damaged area to provide habitat and promote biodiversity.

To maximise Open Space by providing a high ratio of open space to development footprint to promote biodiversity. Alternatively to adopt existing standard in Industrial Environmental Management.

DESCRIPTION

Encourage protection or restoration of the habitat and maximise the ecological diversity by introducing native or adaptive vegetation. Maximise potential for open spaces on grade or on rooftops. One useful strategy is to carefully place building to ensure minimum disruption to the existing ecosystems by minimizing the building/plant footprint. Another is to restore the site area with native or adaptive vegetation; or by increasing the total area for planting by introducing planting on the roof.

Greenfield sites are those that are not previously developed or graded and remain in a natural state. Previously developed sites are those that previously contained building, roadway, parking lot, or were graded or altered by direct human activity.

REQUIREMENTS

Conserve existing natural area and restore damaged area to provide habitat and promote biodiversity.

Maximise Open Space by providing a high ratio of open space to development footprint to promote biodiversity:

1 point: Conservation

- On previously developed or graded site, restore or protect a minimum of 50% of the site area (excluding the building footprint) with native or adaptive vegetation. Native or adaptive plants indigenous to a locality or cultivars of native plants that are adapted to the local climate and are not considered invasive species or noxious weeds. Applicable also to landscaping on rooftops and roof gardens so long as the plants meet the definition of native or adaptive vegetation, OR
- On greenfield sites, limit all site disturbance to within 12m beyond the building/plant perimeter; 3m beyond surface walkway, patio, surface parking and utilities less than 300mm in diameter; 4.5m beyond primary roadway curb and main utility branch trench; and 7.5m beyond constructed area with permeable surface (such as previous paving area, storm water detention facility and playing field) that require additional staging area in order to limit compaction in the constructed area.

1 point: Open Space

- Reduce by 25%, the development footprint (defined as the total area of the building/plant footprint, hardscape, access road and parking) and/or provide vegetated open space within the project boundary to exceed the local zoning's open space requirement for the site by 25%, OR
- For areas with no local zoning requirement, provide vegetated open space adjacent to the building/plant whose area is equal to that of the building/plant footprint, **OR**
- Where zoning ordinance exists, but there is no requirement for open space (zero), provide vegetated open space equal to 20% of the project's site area.

CONTINUED ON NEXT PAGE

SM4	ENVIRONMENT MANAGEMENT (CONTINUED)	2 POINTS
-----	------------------------------------	----------

CONTINUED FROM PREVIOUS PAGE

APPROACH & IMPLEMENTATION

For previously developed or graded sites, during concept design for multi buildings development, ensure that the proposed buildings are located close to one another. This enables more land to be freed up for planting. For a single building/plant development, minimise the footprint or plinth area for the same purpose.

For greenfield sites, similar approach is recommended.

REC	UIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Site plan showing setback dimensions, outlines of building/plant plinth, hardscape and softscape areas (Landscape). (to scale)	0	0
2.	Landscape plans showing the percentage of area covered by native or adaptive vegetation. (to scale)	\circ	0
3.	Name list of plants and characteristics.		
REC	DUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	As-Built coloured Site Plan with marked up outline of building/plant plinth, hardscape and softscape areas.	0	\circ
2.	Landscape As-Built plans showing the percentage area covered by nature or adaptive vegetation.	\circ	0
3.	Describe any deviation or addition to the DA submission.	\circ	\bigcirc

PROJECT NAME	DATE			
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

SM5	NOISE POLLUTION	1 POINT

INTENT

To reduce noise levels diffused from building/plant.

DESCRIPTION

Encourage and recognise buildings/plants that minimise noise levels diffused from the building/plant outside.

REQUIREMENTS

1 point: Awarded where the building/plant envelope is designed to reduce noise penetration by at least NR20dBA when in standard operation mode.

APPROACH & IMPLEMENTATION

Excessive external noise pollution noise will cause discomfort to the neighbourhood. Solutions to mitigate external noise pollution would include:

- Installing sound attenuators to reduce airborne noise emanating from equipment.
- Locating noisy equipment within purpose built enclosures.

RE	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Design report on strategies to ensure external noise level is maintained at the prescribed levels.	\circ	0
2.	Floor plans showing location of the relevant equipment.	\circ	\circ
RE	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	Report describing the measured external noise sources and features installed to achieve required noise level.	0	0
2.	As-Built drawings showing noise control features.	\circ	\circ
3.	Manufacturer's data sheets of the acoustic materials used.	\bigcirc	\circ
4.	Describe any deviation or addition to the DA submission.	0	\circ

PROJECT NAME	PROJECT NAME			
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

NOTE ATTACH ALL SUBMITTALS WITH THIS COVER PAGE

51

SM6

EARTHWORKS – CONSTRUCTION ACTIVITY POLLUTION CONTROL

1 POINT

INTENT

To reduce pollution from construction activities by controlling soil erosion, waterway sedimentation and airborne dust generation.

DESCRIPTION

Construction sites are usually responsible for significant environmental pollution. Encourage the introduction of and implementation of a policy to achieve ALL 3 control objectives for soil erosion, sedimentation (and surface run-off), and air pollution.

REQUIREMENTS

Create and implement an Erosion and Sedimentation Control (ESC) Plan for all construction activities associated with the project. The ESC Plan shall conform to the erosion and sedimentation requirements of the approved Earthworks Plans OR Local erosion and sedimentation control standards and codes, whichever is the more stringent. The plan shall describe the measures implemented to accomplish the following objectives:

- Prevent loss of soil during construction by storm water runoff and/or wind erosion, including protecting topsoil by stockpiling for reuse.
- Prevent sedimentation of storm sewer or receiving stream.
- Prevent polluting the air with dust and particulate matter.

APPROACH & IMPLEMENTATION

A proper ESC Plan should be adopted and understood by consultant and owner early during design stage and captured in the tender exercise.

This is followed by a strict implementation of the ESC Plan during construction.

REC	REQUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)		
1.	Submit proposed ESC Plan.	0	0
REC	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
REC 1.	Submit ESC report, complete with photographic evidence and site reports verified by qualified person.	SUBMITTER	GBI

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

SM7	QLASSIC	1 POINT
SM7	QLASSIC	1 POINT

INTENT

To achieve quality of workmanship in construction works by subscribing to CIDB's Quality Assessment System for Building Construction (QLASSIC).

DESCRIPTION

Reward for achieving minimum score 0f 70% using QLASSIC Assessment System.

REQUIREMENTS

Achieve quality of workmanship in construction works:

Subscribe to independent method to assess and evaluate quality of workmanship of building project based on CIDB's CIS 7: Quality Assessment System for Building Construction Work (QLASSIC). Project should achieve a minimum score of 70%.

APPROACH & IMPLEMENTATION

- In the Project Quality Plan, QLASSIC is to be adopted and understood by all consultants and owner early during design stage and captured in the tender of works.
- All contractors and sub-contractors are to be aware of QLASSIC score targets (tender documentation).
- All contractors and sub-contractors are to be QLASSIC compliance at tender stage and Strict Implementation of QLASSIC during construction to be monitored by qualified person.

RE	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Submit Project Quality Plan and commitment to subscribe to QLASSIC.	0	0
RE	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
RE (QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA) Certified by CIDB of score achieved.	SUBMITTER	GBI

PROJECT NAME		DATE		
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

SM8	WORKERS' SITE AMENITIES	1 POINT

INTENT

To reduce pollution from construction activities by providing proper amenities for workers.

DESCRIPTION

Controlling pollution from waste and rubbish produced by workers is as vital as that from all other construction processes.

REQUIREMENTS

Create and implement a Site Amenities Plan for all construction workers associated with the project.

The plan shall describe the measures implemented to accomplish the following objectives:

- Proper accommodation for construction workers at the site or at temporary rented accommodation nearby.
- Prevent pollution of storm sewer or receiving stream by having proper septic tank.
- Prevent polluting the surrounding area from open burning and proper disposal of domestic waste.
- Provide adequate health and hygiene facilities for workers on site.

APPROACH & IMPLEMENTATION

Site Amenities Plan is intended to achieve the objective of ensuring adequate health and hygiene facilities are available for workers in order to minimize pollution caused by workers.

REC	EQUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)		GBI
1.	Submit Site Plan showing location of all staff and workers' amenities and health & hygiene facilities.	0	0
2.	Submit Building Plan of Site Amenities (to scale).	\bigcirc	\bigcirc
REC	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	Report, complete with photographic evidence and site reports verified by qualified person. Describe any deviation or addition to the DA submission.	0	0

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

NOTE ATTACH ALL SUBMITTALS WITH THIS COVER PAGE

54

SM9

PUBLIC TRANSPORTATION ACCESS & TRANSPORTATION PLAN

1 POINT

INTENT

To reduce pollution and land development impacts from automobile use.

DESCRIPTION

Reduce pollution and land development impacts from private car use. During site selection process, give preference to sites that are located within 1km radius of existing public transportation system.

REQUIREMENTS

Reduce pollution and land development impacts from automobile use:

- · Locate project within 1km of an existing, or planned and funded, commuter rail, light rail or subway station, OR
- Locate project within 500m of at least one bus stop, OR
- Transportation Plan provided to include provision of Factory Bus service, subsidies for Green Vehicles, Car Pool strategies, Van Pool, pick-up service from train station, etc.

APPROACH & IMPLEMENTATION

During concept design stage, plan the building/plant in a manner whereby easy access is available for building/plant users to commute using public transport.

REC	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Submit Site plan showing the site and building orientation, and highlight the locations of existing and planned public transport facilities. (Aerial Google Map is acceptable). Mark the radii from the building entrance to the various transportation systems.	0	0
REG	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
RE (As-Built Site Plan with marked up transportation system facilities and complete with photographic verification.	SUBMITTER	GBI

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

SM10

GREEN VEHICLE PRIORITY – LOW EMITTING & FUEL EFFICIENT VEHICLES

1 POINT

INTENT

To reduce pollution and land development impacts from automobile use.

DESCRIPTION

Provide preferred parking areas for green vehicles, thereby encouraging the use of such vehicles (e.g. hybrid or electric vehicles).

REQUIREMENTS

Encourage use of green vehicles:

- Provide preferred parking for low-emitting and fuel-efficient vehicles by allocating 5% of the total car parks of the building.
- "Preferred parking" refers to the parking spots that are closest to the main entrance of the project (exclusive of spaces designated for handicapped or parking passes provided at a discounted price).

APPROACH & IMPLEMENTATION

Set aside the required number of car park bays to be provided for green vehicles. To further encourage the usage of green vehicles, locate the required car park bays near lift lobbies and/or main entrance.

REC	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Submit calculations for provision of 5% required car park bays for green vehicles.	0	0
2.	Plans showing the locations and numbers of car park bays reserved for green vehicles.	\circ	\circ
REC	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
4			
1.	Submit As-Built plans showing locations and the allocated 5% car park bays for green vehicles	s. ()	\circ
2.	Describe any deviation or addition to the DA submission.		

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

ARKING CAPACITY	1 POINT
	ARKING CAPACITY

INTENT

To reduce pollution and land development impacts from single occupancy vehicle use.

DESCRIPTION

Reward for not over-providing parking capacity. This is to encourage the use of public transport and carpools and reduce single occupancy private vehicle use. The environmental benefits of travelling by public transport include the reduction in the emission of greenhouse gases by private cars, thereby reducing urban pollution and traffic congestion.

REQUIREMENTS

Discourage over-provision of car parking capacity:

- Size parking capacity not exceeding the minimum local zoning requirements, AND
- Provide preferred parking for carpools or vanpools for 5% of the total provided parking spaces.

APPROACH & IMPLEMENTATION

During design planning stage, work out the minimum required number of car park bays. Consult with and inform the local authorities at all times.

RE	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Submit detailed calculation showing the minimum number of car park bays required by the local authorities, and the number of bays provided.	0	0
2.	Submit plans showing location for preferred parking for carpools or vanpools.	\circ	\circ
RE	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	Submit final car park calculations verified by qualified persons.	0	0
2.	Submit As-Built drawings indicating the preferred parking for carpools or vanpools.	\circ	\circ
3.	Describe any deviation or addition to the DA submission.	\bigcirc	\bigcirc

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

SM17	CARGO DELIVERY ROUTE AND PROXIMITY	1 POINT
------	------------------------------------	---------

INTENT

To reduce pollution impacts from cargo transportation use.

DESCRIPTION

Proximity to Major Cargo Transport, e.g. airport, seaport, highway, railway.

REQUIREMENTS

Credit point is awarded where the building/plant is within 10km of at least 2 major cargo services. Major Cargo services are considered to be the following:

- Airport
- Seaport
- Railway station or Rail Yard; AND

are accessible to Major Freeway entrance/exit (within 5km).

REG	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Submit Site plan showing proximity from site to the major cargo services destination eg. Airport, Seaport or Railway Station. (Aerial Google Map is acceptable). Mark the radii from the building/plant entrance to the various transportation systems.	0	0
REG	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
RE (Submit as-built plans of site to the major cargo services destination. Mark the radii from the building/plant entrance to the various transportation systems.	SUBMITTER	GBI

PROJECT NAME	PROJECT NAME			
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

NOTE ATTACH ALL SUBMITTALS WITH THIS COVER PAGE

58

VERSION 1.02 | MARCH 2019

SM13

STORMWATER DESIGN – QUALITY & QUANTITY CONTROL

1 POINT

INTENT

To limit disruption of natural hydrology by reducing impervious cover, increasing on-site infiltration, and managing storm water runoff. Reduce or eliminate water pollution by reducing impervious cover, increasing onsite infiltration, eliminating sources of contaminants, and removing pollutants from storm water runoff.

DESCRIPTION

Minimise impact of stormwater pollution due to development.

REQUIREMENTS

Limit disruption of natural hydrology by reducing impervious cover, increasing on-site infiltration, and managing storm water runoff. Reduce or eliminate water pollution by reducing impervious cover, increasing onsite infiltration, eliminating sources of contaminants, and removing pollutants from storm water runoff:-

Option 1: If Existing Imperviousness is < 50%

Implement a storm water management plan that prevents the post development peak discharge rate and quantity from exceeding the pre-development peak discharge rate and quantity in conformance to the Storm Water Management Manual for Malaysia (MSMA).

Option 2: If Existing Imperviousness is > 50%

Implement a storm water management plan that results in a 25% decrease in the volume of storm water runoff required under MSMA

For either condition, implement a storm water management plan that reduces impervious cover, promotes infiltration, and captures and treats the storm water runoff from 90% of the average annual rainfall using acceptable best management practice (BMPs).

APPROACH & IMPLEMENTATION

During concept design stage, conduct a thorough site evaluation on hydrology of site and prepare a study to reduce the risk of water contamination to nearby water bodies by controlling the quality and quantity of stormwater runoff from the building.

RE	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Submit preliminary study report complying with MSMA requirements.	0	0
RE	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	Report, complete with photographic evidence and site reports signed off by qualified person on final stormwater design and management.	\circ	\circ
2.	Describe any deviation or addition to the DA submission.	\circ	0

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

NOTE ATTACH ALL SUBMITTALS WITH THIS COVER PAGE

59

SM14 GREENERY & ROOF 2 POINTS

INTENT

To reduce heat island effect (thermal gradient difference between developed and undeveloped areas) so as to minimize impact on microclimate and human and wildlife habitat.

DESCRIPTION

- Minimize impact on microclimate and human wildlife habitat.
- Reward for achieving any option. Roof application includes roofs over individual parking lots and roofs over parking structures.
- The use of greenery on rooftops can help alleviate urban heat island effects through shading and evaporative cooling.
 It also enhances aesthetics to the surrounding and provides a more pleasant working environment, which is also discussed in Indoor Environment Quality.

REQUIREMENTS

1 Point: Hardscape & Greenery Application

- 1) Provide any combination of the following strategies for 50% of the site hardscape (including sidewalks, courtyards, plazas and parking lots):
 - Shade (within 5 years of occupancy);
 - Paving materials with a Solar Reflectance Index (SRI) of at least 29;
 - Open grid pavement system;

1 Point: Roof Application

- 1) Use roofing material with a Solar Reflectance Index (SRI) equal to or greater than the value in the table below for a minimum of 75% of the roof surface, *OR*
- 2) Install a vegetated roof for at least 50% of the roof area, OR
- 3) Install high albedo and vegetated roof surfaces that, in combination, meet the following criteria:

(Area of SRI Roof / 0.75) + (Area of vegetated roof / 0.5) > Total Roof Area

 Roof Type
 Slope
 SRI Value

 Low-Sloped
 < 2:12</td>
 78

 Steep-Sloped
 > 2:12
 29

APPROACH & IMPLEMENTATION

NAME

CLIENT

During concept design, ensure landscaping design is incorporated, and choice of materials with preferred SRI is considered. Where possible, introduce landscaping to exposed roof surfaces. Plants used should be of either native or adaptive types.

REC	REQUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)				GBI
1.	Submit Site plan and Roof Plan showi (softscape) (To scale).	ng the extent of propos	ed hardscape and greenery	0	\circ
2.	Section drawing of the rooftop showing	g details of built-up roof	greenery (To scale)	\circ	\bigcirc
3.	List of names of native or adaptive veg	getation and their charac	teristics.	\bigcirc	\bigcirc
REC	QUIRED SUBMISSION FOR COMPLETION	& VERIFICATION ASSES	SSMENT (CVA)	SUBMITTER	GBI
1.	As-Built plans and sections of roof (to	scale). Submit list of mat	erials used and their SRI valu	ies 🔘	0
2.	Submit photographs of roof and mate	rials.		\circ	\circ
3.	Describe any deviation or addition to	the DA submission.		\circ	\circ
DD	DJECT NAME			DATE	
FK	SECT NAME				
	MAME SMITTING SPESSIONAL	DESIGNATION	COMPANY	SIGNATURE	

NOTE ATTACH ALL SUBMITTALS WITH THIS COVER PAGE

60

COMPANY

DESIGNATION

SIGNATURE

SM15	BUILDING USER MANUAL	1 POINT

INTENT

To document Green building design features and strategies for user information and guide to sustain performance during occupation.

DESCRIPTION

A Building User Manual is intended to inform occupants about the active and passive design features that should be maintained throughout the lifespan of the building.

REQUIREMENTS

Provide (include updating) a Building User Manual which documents passive and active features that should not be downgraded.

APPROACH & IMPLEMENTATION

The preparation of the Building User Manual should commence during design concept stage and continue to be developed during all subsequent stages up to and including retro-fitting works. Participation by all consultants and building owner is recommended.

RE	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Commitment to develop Building User Manual and furnish framework of contents.	0	0
RE	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
RE 0	Building User Manual.	SUBMITTER	GBI

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

NOTE ATTACH ALL SUBMITTALS WITH THIS COVER PAGE

61

MR1 MATERIALS REUSE AND SELECTION 2 POINTS

INTENT

To encourage designers to specify the usage of reused building materials in new buildings.

DESCRIPTION

Reuse building materials and products to reduce demand for virgin materials and reduce creation of waste. This serves to reduce environmental impact associated with extraction and processing of virgin resources. Integrate building design and its buildability with selection of reused building materials, taking into account embodied energy, durability, carbon content and life cycle costs.

REQUIREMENTS

- **1 point:** Where reused products/materials constitute \geq 2% of the project's total material cost value, **OR**
- 2 points: Where reused products/materials constitute ≥ 5% of the project's total material cost value.

APPROACH & IMPLEMENTATION

The following approach can achieve this credit by using:

Reused Materials found on site: Fixed components such as doors, cabinetries, posts etc. that no longer serve their original function are refurbished, reconditioned and installed for a different use or in a different location.

Reused Materials found off site: Use of salvaged materials found off site which must have either been previously used or moved/relocated from another facility.

Temporary structures: Temporary formwork, framing and structures etc that can be reused many times before disposal (10 or more cycles of usage) can also be included. If the temporary structures are not a new procurement for this project but have been used previously in other project/s, state the number of uses remaining. The use of system formwork is encouraged.

REC	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	List of anticipated reused or salvaged materials for the project.	\circ	\circ
2.	Cost of each proposed reused or salvaged materials.	\bigcirc	\circ
3.	Establish the estimated Total Cost of the materials for the project excluding MEP items (or use 45% as default value for materials costs; i.e. Total Materials Cost may be derived by multiplying the total construction cost by 0.45) for the project.	0	0
REC	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	Documentation during the construction stage including photographs of the reused materials.	\circ	\circ
2.	List of reused or salvaged materials used in the project after completion and their locations in the building.	\circ	0
3.	Cost of each reused or salvaged materials either based on actual cost paid or replacement value of the material.	0	\circ
4.	Provide the Actual Total Cost of the materials in the project.	\circ	\circ
5.	Describe any deviation or addition to the DA submission.	0	0

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

MR2 RECYCLED CONTENT MATERIALS 2 POINTS

INTENT

To encourage designers to specify the use of recycled content materials in new buildings.

DESCRIPTION

Increase demand for building products that incorporate recycled content materials in their production. Recycled content shall be defined in accordance with the International Organization for Standardization, Document ISO 14021: Environmental labels and declarations – Self declared environmental claims (Type II environmental labelling).

REQUIREMENTS

1 point: Where use of materials with recycled content is such that the sum of post-consumer recycled plus one half of the pre-consumer content constitutes ≥ 10% (based on cost) of the total value of materials in the project, *OR*

2 points: Where use of materials with recycled content is such that the sum of post-consumer recycled plus one half of the pre-consumer content constitutes at least 30% (based on cost) of the total value of materials in the project.

APPROACH & IMPLEMENTATION

The goal in using materials with recycled content should be established during the design phase. The project team must identify materials with recycled content and such availability should be coordinated (as early as possible) by the project team with the contractor, subcontractors and suppliers.

The quantum and value of the recycled content of the materials to the total material cost must be documented by the project team.

A recycled content claim may be made only for materials that have been recovered or otherwise diverted from the solid waste stream, either during the manufacturing process (pre-consumer), or after consumer use (post-consumer)

Post-consumer content is given twice the weightage as it is lot more labour intensive to collect scrap or end of lifecycle product, transport it to the manufacturing plants, treat it, before finally including it into the manufacturing loop.

Formwork submitted as reused material cannot be double accounted under recycled content material since wood is a natural product and will not be considered to have recycled content. However a recycled content material claim may be made where wood fibre (pre- or post-consumer) is included along with another material to form a composite (e.g. recycled wood fibre mixed with recycled plastic to form a composite panel). Wood products made from discarded/off cut wood pieces (i.e. wood pieces that have been diverted from the waste stream) shall also qualify to be considered under this credit.

ISO 14021 definition of Recycled Content Materials:

1) Pre-consumer material

Material diverted from the waste stream during a manufacturing process. Excluded is reutilization of materials such as rework, regrind or scrap generated in a process and capable of being reclaimed within the same process that generated it.

2) Post-consumer material

Material generated by households or by commercial, industrial and institutional facilities in their role as end-users of the product which can no longer be used for its intended purpose. This includes returns of material from the distribution chain.

CONTINUED ON NEXT PAGE

MR2	RECYCLED CONTENT MATERIALS (CONTINUED)	2 POINTS
-----	--	----------

CONTINUED FROM PREVIOUS PAGE

RE	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
		5551111210	
1.	Calculation of the recycled content value of each material must be provided.	\circ	\bigcirc
2.	The percentage of post-consumer and/or pre-consumer recycled content can be established by cost: or by weight (converted to cost).	\circ	0
3.	Information on source/supplier of materials with recycled content must be provided.	\bigcirc	\bigcirc
4.	Submit estimated value of the materials with recycled content against the estimated total value of the materials for the project.	\circ	0
RE	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	Documentation during the construction stage including photographs of the installed reused materials.	\circ	\circ
2.	Calculation of the recycled content value of each material must be provided.	\bigcirc	\bigcirc
3.	Information on source/supplier of the materials with recycled content must be provided.	\circ	\circ
4.	Calculate the total percentage (based on cost) value of the materials with recycled content against the actual total value of the materials for the project. The percentage of post-consumer and/or pre-consumer recycled content must be established by cost.	0	0
5.	Establish the estimated Total Cost of the materials excluding MEP items (or use the 45% default value for materials costs; i.e. Total Materials Cost may be derived by multiplying the total construction cost by 0.45) for the project	0	0
6.	Describe any deviation or addition to the DA submission.	\circ	\circ

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

MR3 REGIONAL MATERIALS 1 POINT

INTENT

To encourage sourcing of regional materials to reduce environmental impacts due to transportation.

DESCRIPTION

Use building materials and products that are extracted and manufactured within the region, thereby supporting the use of indigenous resources and reducing the environmental impacts resulting from transportation.

REQUIREMENTS

Use building materials and products that are extracted, harvested or recovered, as well as manufactured, within 500 km of the project site for > 20% (based on cost) of the total material value.

Mechanical, electrical and plumbing components shall not be included. Only include materials permanently installed in the project.

APPROACH & IMPLEMENTATION

This credit must be evaluated early in the design process as materials and products that can be sourced locally can be identified and included to complement the design intent.

Materials must be assembled as a finished product within the 500 km radius of project site. Assembly as defined for this credit, does not include on-site assembly, erection or installation of finished components, such as curtain-wall assemblies or systems furniture etc.

The project team needs to establish a project strategy with a list of products available regionally and this list needs to be verified with contractors and suppliers to ascertain the availability of the desired materials. This is to ensure a realistic approach to the sourcing of regional materials by the project team that will bring the focus onto materials that will contribute the most to this credit.

CONTINUED ON NEXT PAGE

MR3	REGIONAL MATERIALS (CONTINUED)	1 POINT

CONTINUED FROM PREVIOUS PAGE

RE	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	List of products that are extracted/harvested/recovered and manufactured within 500km of the project site.	\circ	0
2.	Provide the following:	\bigcirc	\bigcirc
	 Name of the manufacturer, Product cost, AND The distance between the project site and the manufacturer. 		
3.	Determine the estimated total Material Cost.	\bigcirc	\circ
4.	If only part of the raw materials for a particular product or assembly originates within 500 km of the project site, provide the percentage (by weight) that these materials is comprised of in the complete product	0	0
5.	Calculate the percentage of regional materials used = Total Cost of Regional Materials (RM) / Total Material Cost (RM)	0	0
RE	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)		
		SUBMITTER	GBI
1.	List of products that are extracted/harvested/recovered and manufactured within 500km of the project site after completion.	SUBMITTER	GBI
1.	List of products that are extracted/harvested/recovered and manufactured within 500km of		GBI
	List of products that are extracted/harvested/recovered and manufactured within 500km of the project site after completion.		GBI
	List of products that are extracted/harvested/recovered and manufactured within 500km of the project site after completion. Provide the following: Name of the manufacturer, Product cost, AND		
2.	List of products that are extracted/harvested/recovered and manufactured within 500km of the project site after completion. Provide the following: Name of the manufacturer, Product cost, AND The distance between the project site and the manufacturer. Determine the Actual Total Material Cost. If only part of the raw materials for a particular product or assembly originates within 500 km of the project site, provide the percentage	0	

PROJECT NAME	DATE			
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

MR4	SUSTAINABLE TIMBER	1 POINT

INTENT

To promote responsible forest management.

DESCRIPTION

Encourage environmentally responsible forest management.

REQUIREMENTS

Where \geq 50% of wood-based materials and products used are certified. These components include, but are not limited to, structural framing and general dimensional framing, flooring, sub-flooring, wood doors and finishes. To include wood materials permanently installed and also temporarily purchased for the project. Compliance with Forest Stewardship Council and Malaysian Timber Certification Council requirements.

APPROACH & IMPLEMENTATION

Establish the volume and types of wood products used in the project. Check the availability of the wood species and products that complies with FSC and MTCC requirements by making contact with the local vendors, suppliers and manufacturers that provide the required certifications.

Provide a list of certified vendors, suppliers and manufacturers to the contract bidders.

KEU	INIKEN PARMIPPIAN LAK MEPIRU YPPEPPUMEN I (NY)	SUBMITTER	GBI
1.	List all new wood products specified in the project and identify which components are FSC and MTCC certified.	0	0
2.	Indicate the estimated volume of each wood product.	\circ	0
REC	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	List all new wood products used in the project and identify which components are FSC and MTCC certified.	0	0
2.	The volume of each wood product must be shown.	\circ	\circ
3.	The vendor's chain-of-custody (COC) number must be shown in the invoice to verify FSC and MTCC certifications.	\circ	0
4.	Describe any deviation or addition to the DA submission.	\bigcirc	\bigcirc

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

MR5 STORAGE & COLLECTION OF RECYCLABLES

1 POINT

INTENT

To provide dedicated areas and storage bins for non-hazardous materials for recycling during BOTH construction and building occupancy.

DESCRIPTION

Facilitate reduction of waste generated during construction and during building/plant occupancy that is hauled and disposed of in landfills.

REQUIREMENTS

Provide dedicated area/s and storage for collection of non-hazardous materials for recycling during construction, AND

Provide permanent recycle bins and where applicable, dedicated scheduled waste area complying with EQA on scheduled waste requirement during building/plant occupancy.

APPROACH & IMPLEMENTATION

During construction, designate a dedicated area where on-site sorting of waste materials can be stored in separate skips for collection to recycling facilities.

During Building Occupancy, designate storage areas for recyclable materials that are clearly labelled for recycling, placed within accessible reach of the building occupants and in a location with easy vehicular access to facilitate collection.

The size of the storage space allocated should be adequate to store the recyclable waste volume generated by the building occupants/operation.

Identify and include a list of recycling facilities that are able to handle and treat the recyclable waste diverted from landfills by the building occupants/operation.

RE	QUIRED SUBMISSION FOR DESIGN ASSI	ESSMENT (DA)		SUBMITTER	GBI
1.	Floor plans showing the proposed loo proximity to the building entrance and			0	0
2.	Ensure that the space provided for recyclables is in addition to the storage space allocated for general waste.			0	0
RE	QUIRED SUBMISSION FOR COMPLETION	& VERIFICATION ASSES	SSMENT (CVA)	SUBMITTER	GBI
1.	As-built plans showing the locations of the storage area for recyclables. The plans should indicate the proximity of the storage from the building entrance.			0	0
2.	Photographs showing the location, size, storage provision and labelling of dedicated facilities during construction.				0
3.	Describe any deviations or additions to the DA submission.			\circ	0
PR	OJECT NAME			DATE	
	BMITTING OFESSIONAL	DESIGNATION	COMPANY	SIGNATURE	
	NAME	DESIGNATION	COMPANY	SIGNATURE	

NOTE ATTACH ALL SUBMITTALS WITH THIS COVER PAGE

CLIENT

MR6 CONSTRUCTION WASTE MANAGEMENT 2 POINTS

INTENT

To reduce and recycle construction waste materials and divert from disposal to landfills.

DESCRIPTION

Develop and implement a construction waste management plan that, as a minimum identifies the materials to be diverted from disposal regardless of whether the materials will be sorted on site or co-mingled. Use Compactor and Baler for waste disposal.

REQUIREMENTS

Quantify by measuring total truck loads of waste sent for disposal:

1 point: Recycle and/or salvage > 50% volume of non-hazardous construction debris, OR

2 points: Recycle and/or salvage > 75% volume of non-hazardous construction debris.

APPROACH & IMPLEMENTATION

A waste management plan must be developed and types of construction waste identified. Excavated soil must be excluded in the calculation.

Identify construction haulers and recyclers to handle the designated construction waste and ensure that records are kept to verify that the materials diverted have been recycled or salvaged as intended.

Use of pre-cast reduces waste produced on site.

REC	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Tabulate the anticipated diverted/recycled/landfill waste and the estimated quantity of the diverted/recycled/landfill waste.	0	0
REC	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	Submit verified record of truck loads of diverted/recycled/landfill waste against total truck loads, supported by copy of the construction waste management plan.	\circ	0
2.	A detailed project construction waste management plan produced by the contractor must be submitted along with evidence supporting the waste recycling programme such as Photographs, waste receipts from recycling facilities, authorized documents from the receiving sites/plants/recycling facilities, tabulation of waste disposed and recycled, etc.	0	0
3.	Describe any deviation or addition to the DA submission.	0	0

PROJECT NAME	PROJECT NAME			
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

MR7 REFRIGERANTS & CLEAN AGENTS 1 POINT

INTENT

To demonstrate leadership in accelerating phase-out of all Ozone Depleting Substances. Recognise and promote use of low Global Warming Substances.

DESCRIPTION

Use environmentally-friendly Refrigerants and Clean Agents exceeding Malaysia's commitment to the Montreal & Kyoto protocols.

REQUIREMENTS

Use zero Ozone Depleting Potential (ODP) products: non-CFC & non-HCFC refrigerants AND clean agents,

APPROACH & IMPLEMENTATION

Use synthetic refrigerants (for HVAC) and clean agents (for fire fighting) with zero ODP such as HFCs that exceeds Malaysia's commitment to the Montreal & Kyoto protocols.

Use non-synthetic (natural) refrigerants (for HVAC) and clean agents (for fire fighting) with zero ODP and negligible Global Warming Potential (GWP) such as water, hydrocarbon, carbon dioxide, ammonia and etc (for HVAC); and nitrogen, argon, water mist and etc (for fire fighting); will qualify for additional credit point under Innovation.

RE	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	Submit proposed types of refrigerants and clean agents to be used and/or if no refrigerants and clean agents will be used.	0	0
RE	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI

PROJECT NAME	PROJECT NAME			DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

WATER EFFICIENCY (WE)

WE1	RAINWATER HARVESTING	2 POINTS
WE1	RAINWATER HARVESTING	2 POINTS

INTENT

To encourage rainwater harvesting that will lead to reduction in potable water consumption.

DESCRIPTION

Maximise rainwater collection from rooftop or runoff rainwater systems for building consumption and/or irrigation.

REQUIREMENTS

1 point: Rainwater harvesting that leads to ≥ 15% reduction in potable water consumption, *OR*

2 points: Rainwater harvesting that leads to ≥ 30% reduction in potable water consumption.

APPROACH & IMPLEMENTATION

The two (2) main approaches to rainwater harvesting are collection of runoff rainwater from surrounding site and roof top rainwater harvesting. Both systems require separate water storage tanks and additional pressure boosting equipment may be required. Gravity fed system is encouraged to avoid additional energy use for pumping. Use rainwater for non-potable applications such as toilets and urinal flushing, landscape irrigation, washing floors, industrial process, etc.

Water purifying system may be necessary depending on the application and methodology of harvesting the rainwater. Where rainwater filtration/purification is required, use of ozone or activated oxygen in lieu of chlorine or other GHG chemicals, is preferred to obviate negative environmental impact.

Rainwater harvesting calculation method and parameters adopted using GBI recognized Standards, Codes or Guides are acceptable.

REC	DUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	A technical report describing the concept and details of rainwater collection, conveyance system (gutters/downpipes or equivalent), filtration system (if any), storage facility and distribution system.	0	0
2.	The technical report shall include schematics showing how the rainwater is to be harvested and utilised.	0	0
REC	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	Final as-installed calculation of rainwater harvested, storage tank capacity and building usage distribution system.	0	\circ
2.	As-Built drawings for rainwater harvesting system and storage tank location (Recommended scale 1:200).	0	0
3.	Furnish photographs of as installed main equipment and components.	\bigcirc	\circ
4.	Describe any deviation or addition to the DA submission.	0	\circ

PROJECT NAME	DATE			
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

NOTE ATTACH ALL SUBMITTALS WITH THIS COVER PAGE

73

WE2 WATER RECYCLING 2 POINTS

INTENT

To encourage water recycling that will lead to reduction in potable water consumption.

DESCRIPTION

Encourage recycling of greywater and/or blackwater for building and irrigation use to reduce discharge to external sewer, thereby reducing the overall building potable water consumption.

Encourage and recognise building design that reduces water flow to sewerage treatment plants.

REQUIREMENTS

Treat and recycle the following percentage of wastewater leading to reduction in potable water consumption:

1 point: For ≥ 10% or more wastewater being treated and recycled, OR

2 points: For ≥ 30% or more wastewater being treated and recycled.

APPROACH & IMPLEMENTATION

Water treatment systems and re-use technology options are acceptable for treating greywater and blackwater. The treated water is then recycled for use in irrigation, toilet flushing etc. Sand filters can be a cost effective treatment technique.

POTENTIAL TECHNOLOGIES & STRATEGIES

Consider channelling greywater from sinks, showers and other sources to wastewater treatment plant.

Options for on-site wastewater treatment include packaged biological nutrient removal systems and high efficiency filtration systems can be considered.

REC	UIRED SU		SUBMITTER	GBI		
1.	Prelimina recycled.	ry calculation to demonstrate	e the percentage of wa	stewater to be treated and	0	0
2.	2. A technical report describing the concept and details of the recycling and treatment plant, conveyance system, storage facility and distribution system.					\circ
3.		nical report shall include sch d utilised.	nematics showing how	the wastewater is recycled,	0	0
REC	UIRED SU	SUBMITTER	GBI			
1.		nstalled calculation of the rec	ycled and treated waste	water, storage tank capacity	0	0
2.	As-Built o	drawings for wastewater recycl	ling and treatment syste	m, and storage tank location	\circ	\circ
3.	Describe	any deviation or addition to t	he DA submission.		0	\circ
PRO	PROJECT NAME DATE					
	SUBMITTING PROFESSIONAL NAME DESIGNATION COMPANY S		SIGNATURE			
CLI	CLIENT DESIGNATION COMPANY			SIGNATURE		

WE3

WATER EFFICIENT IRRIGATION/ LANDSCAPING

2 POINTS

INTENT

To encourage and recognise the design of landscaping system that minimises or does not require the use of potable water supply from the local water authority.

DESCRIPTION

The main aim is to reduce the consumption of potable water for landscape irrigation. This may be achieved through the use of native or adaptive plants to reduce potable water consumption.

REQUIREMENTS

1 point: For reducing potable water consumption for landscape irrigation by 50% or more, OR

2 points: For not using potable water at all for landscape irrigation.

APPROACH & IMPLEMENTATION

Design a water-efficient landscape by selecting native or adaptive plants that require minimal water. Reduce or eliminate use of potable water for landscape irrigation system.

POTENTIAL TECHNOLOGIES & STRATEGIES

Perform soil / climate analysis to determine appropriate plant material and design the landscape with native or adaptive plants to reduce or eliminate irrigation requirements. Where irrigation is required, use high efficiency equipment and/or climate based controllers.

REC	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	A brief description of the system with references to Guidelines used, calculations, and an explanation of how the system meets the requirement for the credit.	0	0
2.	A brief report by a landscape architect detailing the selection of native adaptive vegetation and the water efficient irrigation system and demonstrating that it will meet all the requirements for the credit.	0	0
REC	DUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
REC	As-Built plans showing the detail location of the planted native adaptive vegetation and installed water efficient irrigation system (to scale).	SUBMITTER	GBI
	As-Built plans showing the detail location of the planted native adaptive vegetation and	SUBMITTER	GBI
1.	As-Built plans showing the detail location of the planted native adaptive vegetation and installed water efficient irrigation system (to scale).	SUBMITTER	GBI

PROJECT NAME	DATE			
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

WE4	WATER REDUCTION	2 POINTS
-----	-----------------	----------

INTENT

To encourage reduction in potable water consumption through use of efficient devices/industrial process.

REQUIREMENTS

1 point: Reduce annual potable water consumption by \geq 30%, *OR* **2 points:** Reduce annual potable water consumption by \geq 50%.

APPROACH & IMPLEMENTATION

The use of water efficient water closets, wash hand basins or shower heads or systems which has the potential to reduce potable water consumption in the building and industrial process.

Specify the use of automatic self-closing faucets, electronic or otherwise, to eliminate wastage through faucets left running unnecessarily.

Specify the use of modified waterless urinals.

RE	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)	SUBMITTER	GBI
1.	A brief description of the system and an explanation of how the system meets the requirement for the credit.	0	0
2.	Submit proposed makes of the intended fittings.	\circ	0
REC	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	Actual verified water consumption for the building.	\circ	0
2.	Tabulation of all as-installed water efficient fittings and calculations to verify percentage of water saved to meet the requirement for the credit.	0	\circ
3.	Submit manufacturer's details of the installed fittings.	\circ	\circ
4.	Furnish photographs of each type of water efficient fittings as installed.	\bigcirc	\bigcirc
5.	Describe any deviation or addition to the DA submission.	\bigcirc	\circ

PROJECT NAME	DATE			
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

WE5	METERING & LEAK DETECTION SYSTEM	2 POINTS
WE5	METERING & LEAK DETECTION SYSTEM	2 POINTS

INTENT

To encourage the design of systems that allows monitoring and management of water consumption.

REQUIREMENTS

- **1 point:** Use of sub-meters to monitor and manage major water usage for cooling towers, irrigation, kitchens, tenancy use, and industrial process use.
- 1 point: Link all water sub-meters to EMS to facilitate early detection of water leakage.

APPROACH & IMPLEMENTATION

Specify the provisions of sub-meters for major water consuming system/equipment. Incorporate EMS monitoring system of sub-meters.

POTENTIAL TECHNOLOGIES & STRATEGIES

To incorporate provisions of analogue or digital flow water sub-meters.

Incorporation of EMS monitoring will enable early detection of water leakage and contain water wastage.

REC	REQUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)			
1.	Describe proposed provision of sub-meters of all major water consuming system/equipment and interface with EMS.	0	0	
REC	UIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI	
1.	Submit tabulated inventory of as-installed sub-meters.	\circ	\circ	
2.	As-Built plans of the building showing the location of sub-meters.	\bigcirc	\bigcirc	
3.	Furnish photographs of typical sub-meter installed.	\bigcirc	\bigcirc	
4.	Sample of actual EMS report recording consumption and simulated leakage.	\bigcirc	\bigcirc	
5.	Describe any deviation or addition to the DA submission.	\circ	\circ	

PROJECT NAME				DATE
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

NOTE ATTACH ALL SUBMITTALS WITH THIS COVER PAGE

VERSION 1.02 | MARCH 2019

INNOVATION (INC) (IN)

INDUSTRIAL NEW CONSTRUCTION (INC) INNOVATION (IN)

IN1

INNOVATION & ENVIRONMENTAL DESIGN INITIATIVES

6 POINTS

INTENT

To provide opportunity for the project to be awarded points for exceptional performance above the requirements set by GBI rating system.

DESCRIPTION

Reward innovation and initiatives.

REQUIREMENTS

Encourage project team to score points for exceptional performance above the requirements set by GBI rating system:

1 point for each approved innovation and environmental design initiative up to a maximum of 6 points, for innovative ideas such as, but not limited to:

- Condensate water recovery (accounting for at least 50% of total AHUs/FCUs) for use as cooling tower make-up water, etc.
- Co-generation / Tri-generation system
- Thermal / PCM / Thermal Mass storage system (accounting for at least 25% of total required capacity)
- Solar thermal technology / Solar Air conditioners (generating at least 10% of total required capacity)
- Heat recovery system (contributing to at least 10% of total required capacity)
- Heat pipe technology
- Light pipes accounting for at least 1% of NLA
- · Auto-condenser tube cleaning system (fitted to plant equipment serving at least 50% of total capacity)
- Non-chemical water treatment system for condenser or chilled water circuit (e.g. air and dirt separator, vacuum degasser, etc)
- Dynamic balancing control valve system (for entire chilled water system)
- Mixed mode / low energy ventilation system
- Advanced air filtration technology (serving at least 50% of the waterless urinals fitted to all male toilets)
- Central vacuum system (serving at least 50% of NLA)
- Central Pneumatic Waste Collection system
- Self-cleaning façade

VERSION 1.02 | MARCH 2019

- Electrochromic glazed façade
- Refrigerant leakage detection and recycling facilities
- Use non-synthetic (natural) Refrigerants AND Clean Agents with zero ODP and negligible Global Warming Potential
- ISO 14000 series certification
- Recycling of all fire systems water during regular testing
- Use of Industrialized Building System (IBS) with minimum CIDB IBS score of 30

APPROACH & IMPLEMENTATION

During Concept Design Stage, commence discussions on all possible innovation ideas to be incorporated into the building early. Late incorporation of innovation ideas may be difficult and costly.

RE	QUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)					GBI
1.		Report on each innovation, how it is derived, and how it would assist in reducing energy and/or improving sustainable design.			0	0
RE	QUIRED SU	BMISSION FOR COMPLETION	& VERIFICATION ASSES	SSMENT (CVA)	SUBMITTER	GBI
1.	Full documentation and photographic evidence of each innovation, and the process from commencement to commissioning, complete with drawings, manuals and maintenance write-up.					0
2.	. Describe any deviation or addition to the DA submission.			0	0	
Р	ROJECT NAME				DATE	
_	SUBMITTING PROFESSIONAL NAME DESIGNATION COMPANY			SIGNATURE		
С	LIENT	NAME	DESIGNATION	COMPANY	SIGNATURE	

INDUSTRIAL NEW CONSTRUCTION (INC) INNOVATION (IN)

IN₂

GREEN BUILDING INDEX FACILITATOR

1 POINT

INTENT

To support and encourage the design integration required for Green Building Index rated buildings and to streamline the application and certification process.

DESCRIPTION

Encourage and promote green technology service providers.

REQUIREMENTS

Support and encourage the design integration required for Green Building Index rated buildings and to streamline the application and certification process, where:

At least one principal participant of the project team shall be a Green Building Index Facilitator who is engaged at the onset of the design process until completion of construction and Green Building Index certification is obtained. Name of the GBI Facilitator shall be inserted in GBI Application & Registration Form.

APPROACH & IMPLEMENTATION

Appoint a Green Building Index Facilitator early to assist in the concept design stage, and ensure that the Facilitator follows through the entire project.

REQUIRED SUBMISSION FOR DESIGN ASSESSMENT (DA)			GBI
1.	Proof of appointment of the named GBI Facilitator.	\circ	\circ
2.	GBI Facilitator to present DA submission to GBI Certifier.	0	\circ
RE	QUIRED SUBMISSION FOR COMPLETION & VERIFICATION ASSESSMENT (CVA)	SUBMITTER	GBI
1.	GBI Facilitator to present CVA submission to GBI Certifier.	\circ	\circ

PROJECT NAME			DATE	
SUBMITTING PROFESSIONAL	NAME	DESIGNATION	COMPANY	SIGNATURE
CLIENT	NAME	DESIGNATION	COMPANY	SIGNATURE

ACKNOWLEDGEMENTS

GSB would like to thank all contributors for efforts in preparing the INDUSTRIAL NEW CONSTRUCTION (INC) Design Reference Guide Version 1.0. The following are the main contributors to the formation of this document:

GBI INDUSTRIAL NEW CONSTRUCTION (INC)

Chen Thiam Leong	Association of Consulting Engineers Malaysia (ACEM)
Au Chong Hun	Association of Consulting Engineers Malaysia (ACEM)
Ahmad Izdihar	Association of Consulting Engineers Malaysia (ACEM)
Wong Kian Lon	Association of Consulting Engineers Malaysia (ACEM)
Dr Kribanandan GN	Association of Consulting Engineers Malaysia (ACEM)
Leong Siew Meng	American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc. – Malaysia Chapter (MASHRAE)
Ng Yong Kong	American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc. – Malaysia Chapter (MASHRAE)
Lam Kim Seong	American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc. – Malaysia Chapter (MASHRAE)
Looi Hip Peu	Malaysian Green Building Confederation (MGBC)
Thirukumaran Jallendran	Malaysian Green Building Confederation (MGBC)
Dr Nurul Muiz Murad	Malaysian Green Building Confederation (MGBC)
Von Kok Leong	Pertubuhan Arkitek Malaysia (PAM)
Ahmad Ridha	Pertubuhan Arkitek Malaysia (PAM)
Faizul Ideris	Federation of Manufacturers Malaysia (FMM)
Wong Siew Sheng	Malaysia Air-Conditioning & Refrigeration Association (MACRA)